


KEYNOTES

- U1 PROVIDE NEMA 4X ENCLOSURE ADJACENT TO MONUMENT SIGN CONTAINING SINGLE-MODE FIBER MEDIA CONVERTER, 120V POWER CONNECTION, AND SURGE PROTECTION. ENCLOSURE SHALL RECEIVE FIBER FROM NEAREST HANDHOLE AND PROVIDE RJ-45 CONNECTION TO SIGN CONTROLLER. COORDINATE FINAL LOCATION, POWER REQUIREMENTS, AND MOUNTING DETAILS WITH SIGN AND SITE CONTRACTORS.
- U2 WEATHERPROOF JUNCTION BOX FOR BACKFLOW HEATER. COORDINATE WITH CIVIL CONTRACTOR FOR EXACT LOCATION AND MORE INFORMATION.
- U3 COORDINATE EXACT LOCATION AND QUANTITY OF TAMPER SWITCHES WITH CIVIL/SPRINKLER CONTRACTOR. PROVIDE CONNECTION TO SCHOOL FIRE ALARM SYSTEM.
- U4 PROVIDE FUTURE CONDUIT(S) AS SHOWN. CAP AND SEAL ALL UNUSED ENDS TO PREVENT WATER OR DEBRIS INTRUSION. INCLUDE 1000 LB TEST MULETAPE AND TRACER WIRE IN EACH CONDUIT.
- U6 PROVIDE 3-INCH CONDUIT BENEATH SLAB ACROSS LOBBY 020 FOR DOOR POSITION SWITCH CABLING ROUTED TO TELECOM ROOM 015. COORDINATE THE EXACT ROUTE AND VERTICAL TRANSITION WITH THE ARCHITECT, STRUCTURAL DRAWINGS, AND OTHER TRADES PRIOR TO SLAB PLACEMENT.

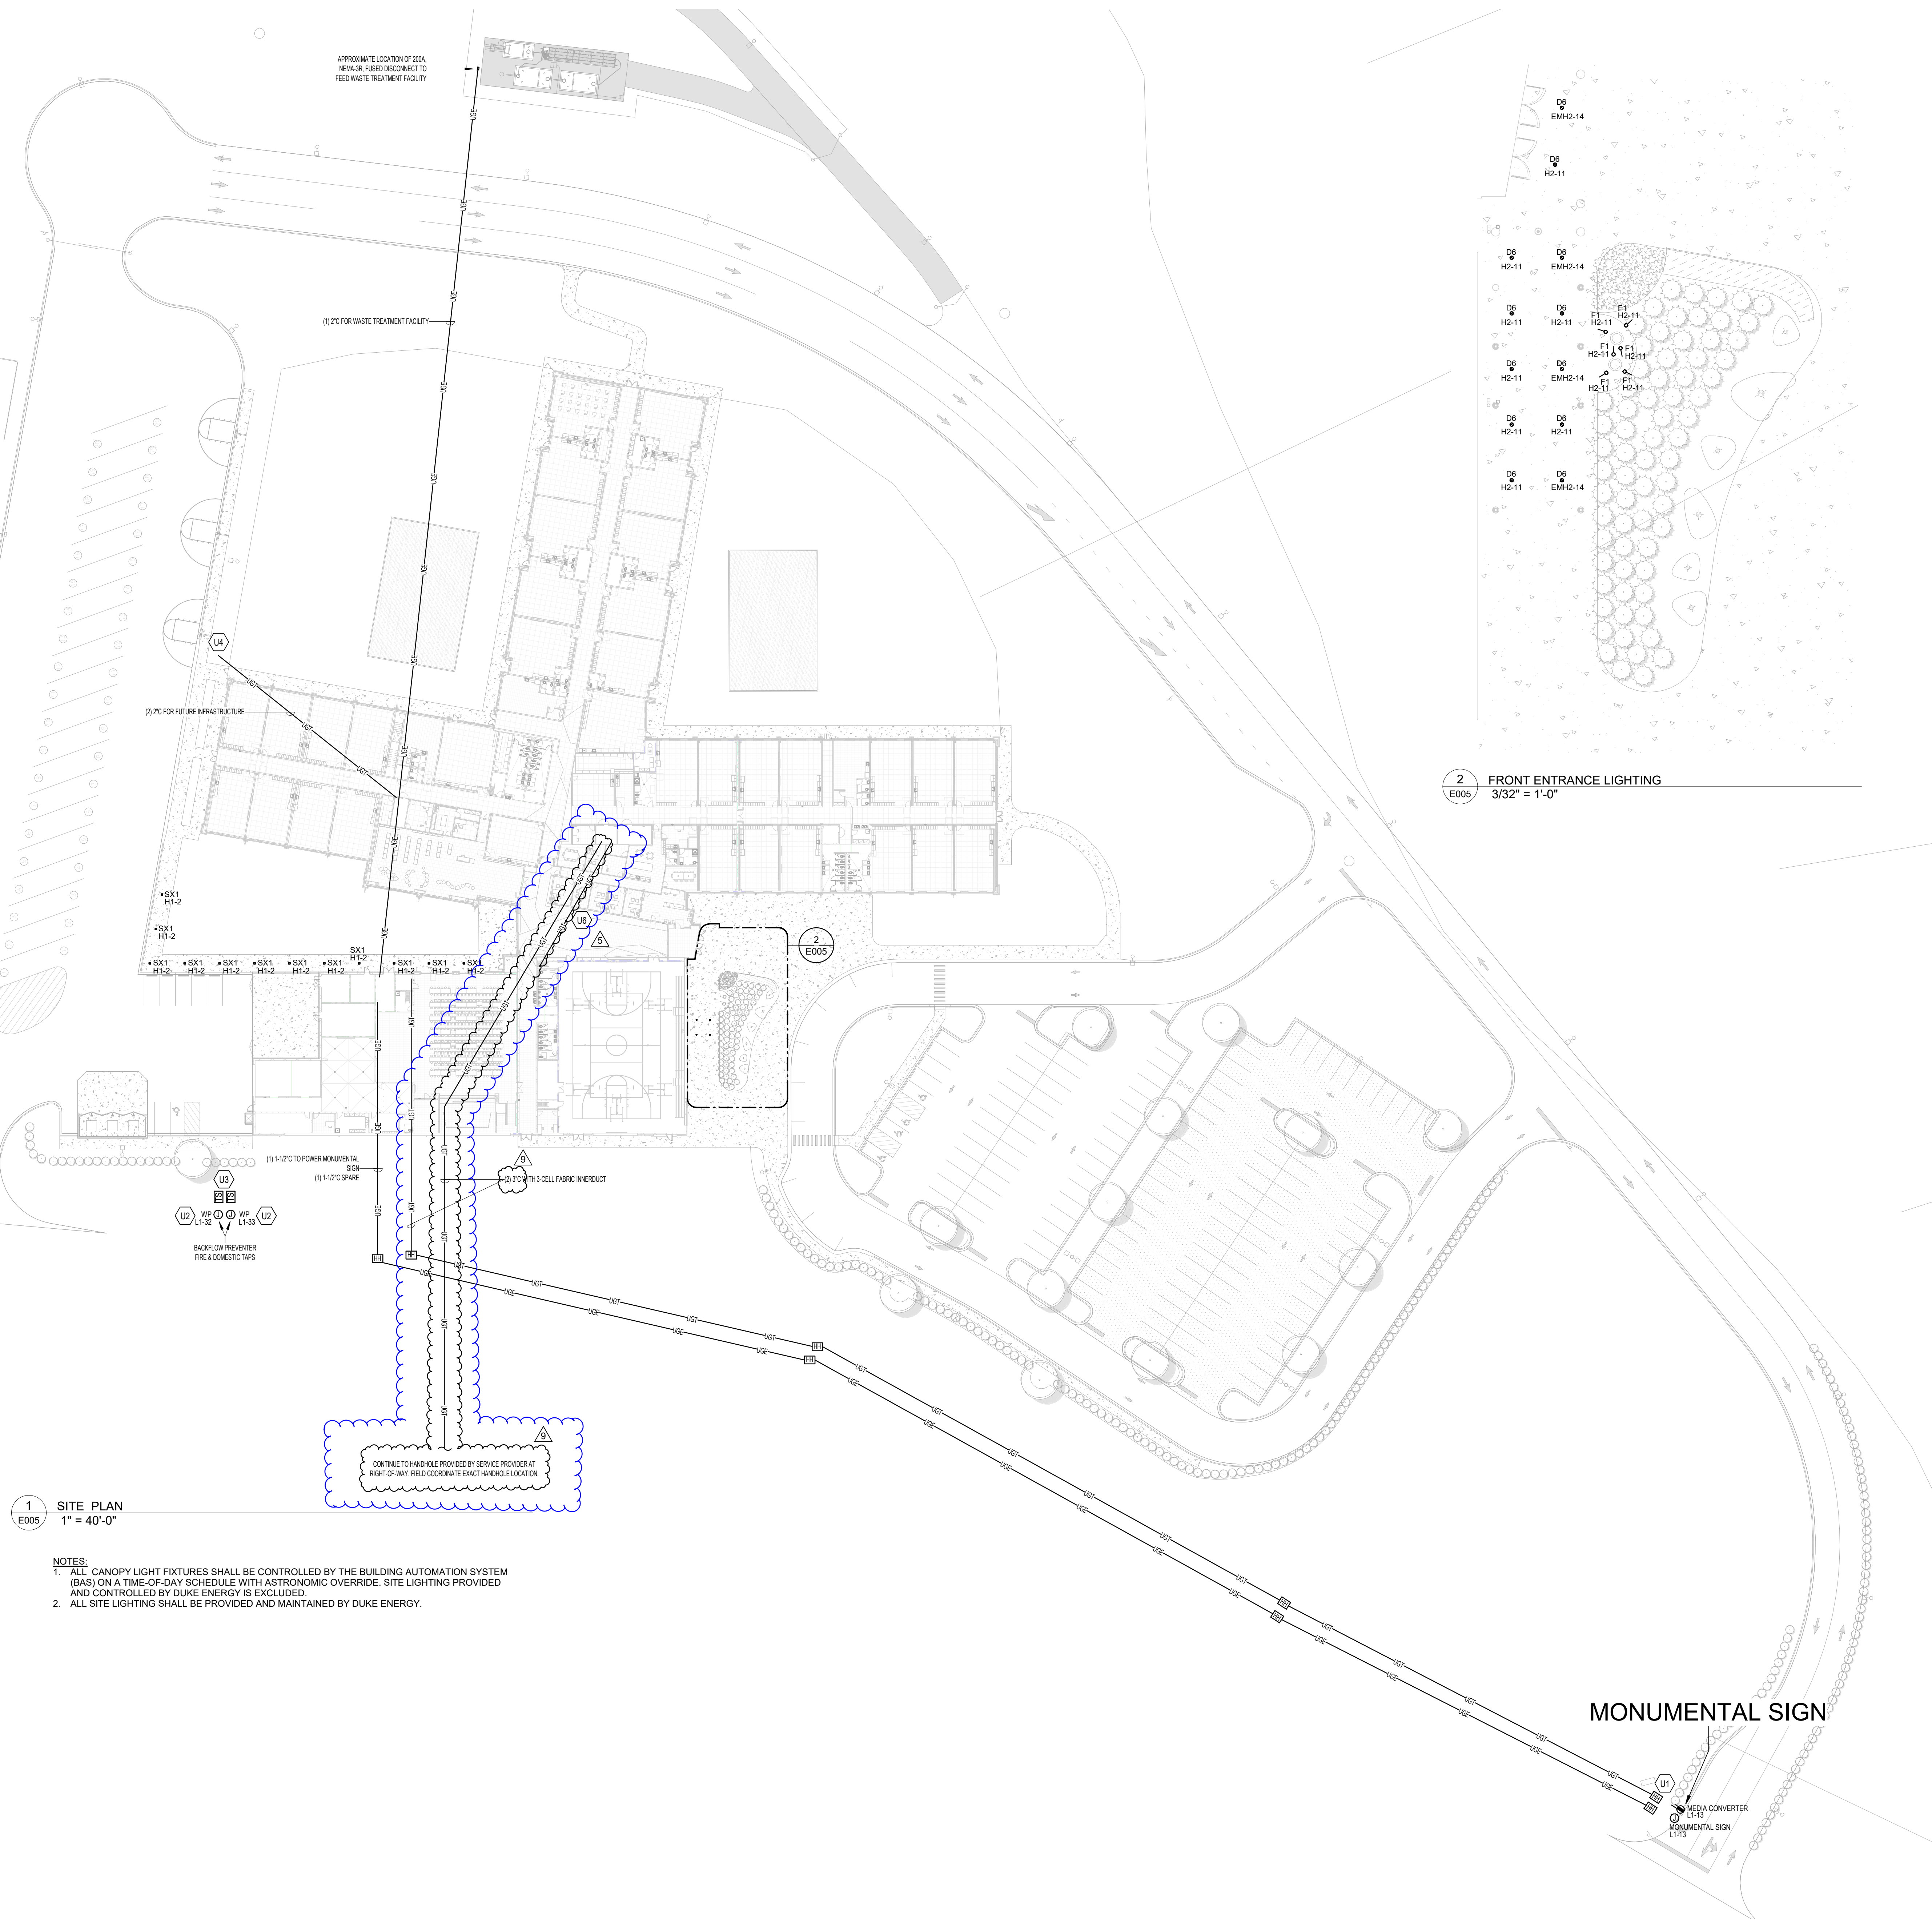

CONSTRUCTION DOCUMENTS

ISS PARKERTOWN ELEMENTARY

218 PARKERTOWN
RD, MOORESVILLE,
NC 28115

SITE PLAN

DATE: 01.27.2026
PROJECT NO: 24011

REVISIONS		
NO.	DATE	DESCRIPTION
5	07.29.2026	Low Voltage Coordination
9	09.23.2026	Owner Coordination

THIS DRAWING IS THE PROPERTY OF ADW ARCHITECTS, P.A. AND SHALL NOT BE REPRODUCED OR COPIED IN WHOLE OR PART. IT SHALL NOT BE USED ON ANY OTHER PROJECT OR GIVEN TO ANY OTHER COMPANY OR AGENCY WITHOUT THE CONSENT OF ADW ARCHITECTS, P.A.