McKinney Independent School District, TX
Procurement
Laura Duree, Director of Purchasing
1 Duvall St, Mckinney, TX 75069
(972) 542-7410

QUESTION & ANSWER REPORT

RFP No. 2026-10-652

E-RATE CATEGORY 2

RESPONSE DEADLINE: December 11, 2026 at 2:00 pm

Tuesday, November 17, 2026

Approved, Unanswered Questions

Approved, Answers Provided

1. E-Rate_Category_2_(Addendum_#1_Revision) Document, Page 37

Nov 2, 2026 8:50 AM

Question: The McKinney ISD Approved Parts List includes Door Hinges, Cage Nuts/Screws and Cable Management Chases. Please provide quantities we need to include within our proposal for these items.

Nov 2, 2026 8:50 AM

Answered by Stephen McGilvray: The McKinney ISD Approved Parts List is a list of approved parts or equivalent. Refer to the rack elevations for each network closet in the supporting attachment of the RFP to determine the parts and accessories needed.

Nov 17, 2026 9:50 AM

2. E-Rate_Category_2_(Addendum_#1_Revision) Document, Page 39

Nov 2, 2026 8:50 AM

Question: The McKinney ISD Approved parts list includes Panduit Wire Basket Tray and related items. Is it acceptable to utilize a different manufacturer such as Cablofil, WBT, Basor, etc. in lieu of Panduit?

Nov 2, 2026 8:50 AM

Answered by Stephen McGilvray: The specifications list all Panduit items or equivalent. This is also referenced in the MCKINNEY ISD APPROVED PARTS LIST OR EQUIVALENT section. All equivalent manufacturer part numbers will be considered. Please provide specifications detailing how the part is equivalent to the part listed.

Nov 17, 2026 9:50 AM

3. E-Rate_Category_2_(Addendum_#1_Revision) Document

Nov 2, 2026 8:51 AM

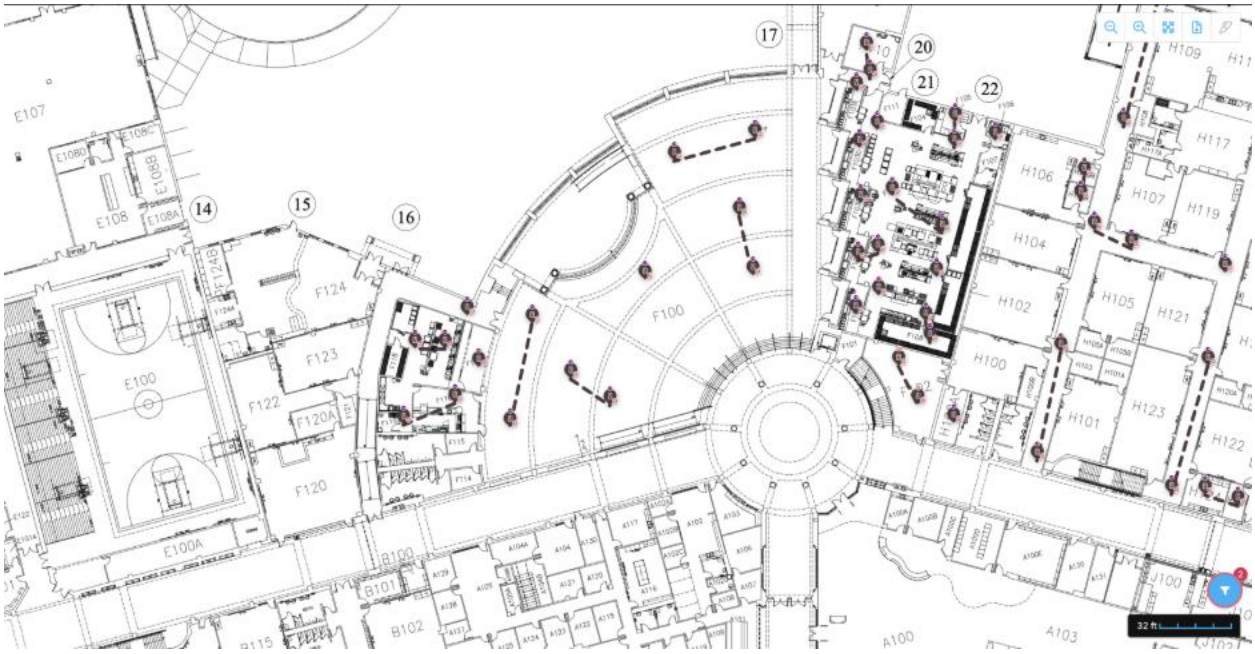
Question: Page 41 installation specifications indicates we are to run 18/2 between extension speakers and close IP ceiling speakers. Please provide drawings indicating the Extension Speakers and close IP ceiling speaker locations, or provide an estimated distance for cable & supports allocation.

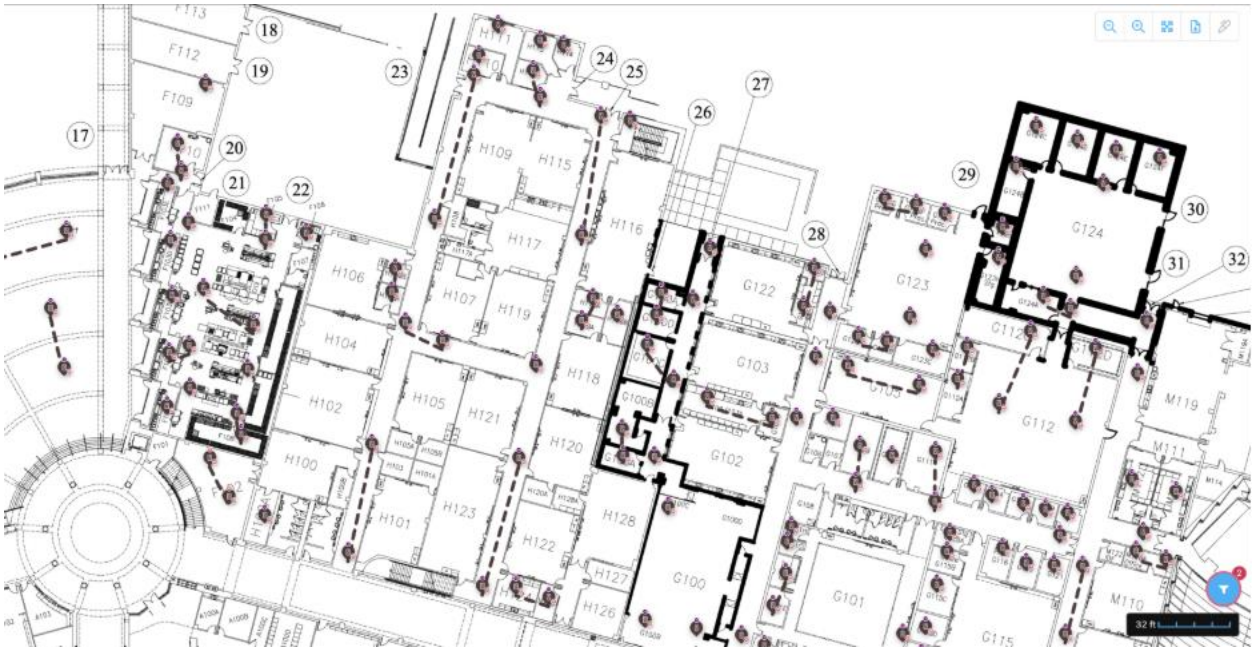
Nov 2, 2026 8:51 AM

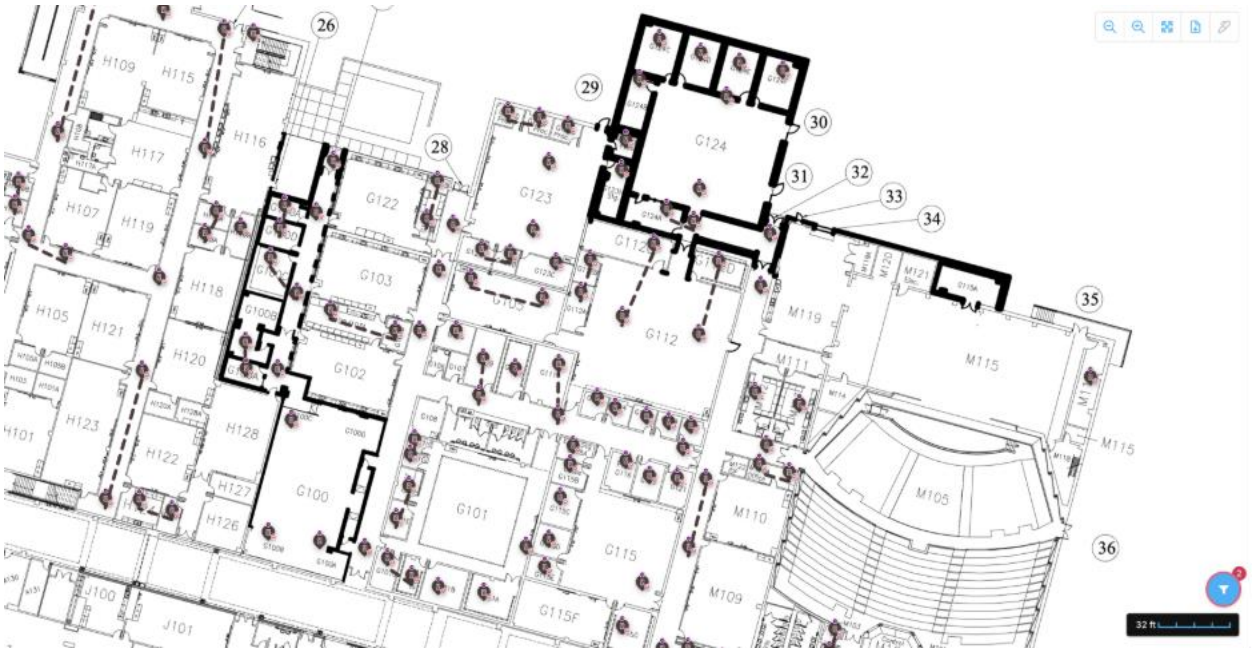
Answered by Laura Duree: The speaker & extension speaker locations will be provided in an addendum.

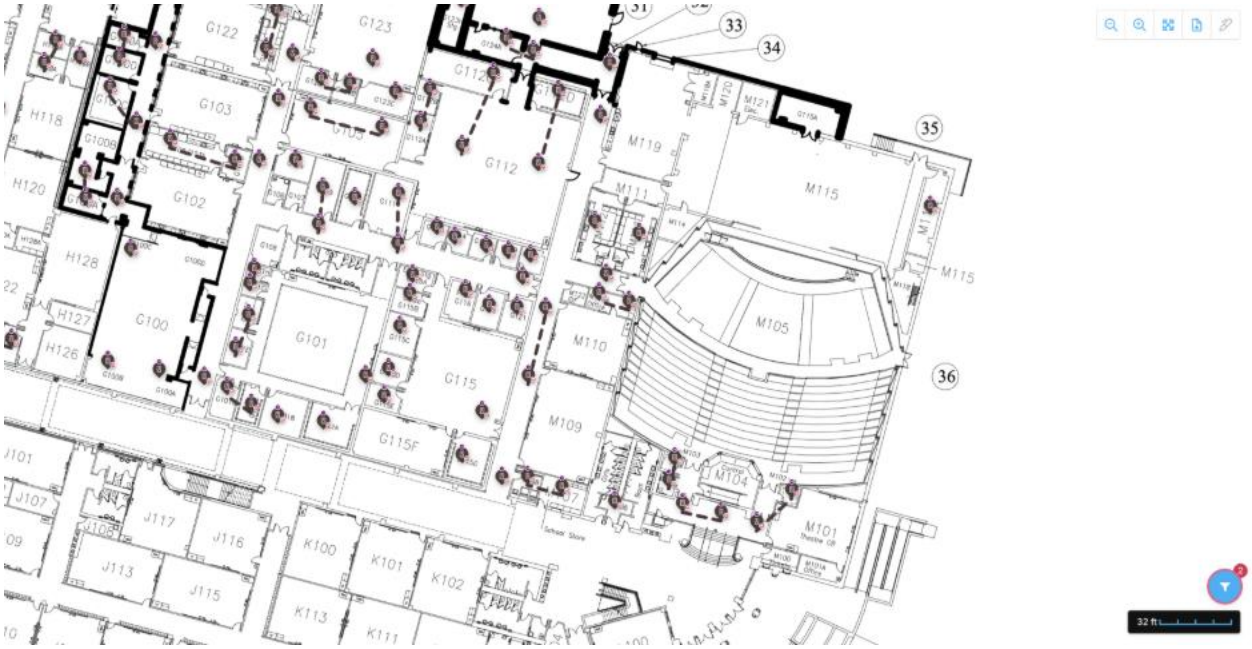
MCKINNEY BOYD HIGH SCHOOL FLOOR 1:




17
20
21
22
14
15
16
E107
E108
E108A
E108B
E108C
E100
E100A
F124
F123
F122
F120A
F120
F100
H109
H117
H106
H107
H119
H104
H102
H105
H121
H100
H101
H123
H122
B100
B101
B102
A100
A103
32 ft


18
19
23
24
25
27
26
17
20
21
22
29
30
31
32
28
F112
F109
H109
H115
H116
H117
H106
H107
H119
H104
H102
H105
H121
H120
H118
H100
H101
H123
H122
H128
H127
H126
G122
G123
G124
G103
G102
G112
G100
G101
M119
M111
M110
G115
32 ft


26
29
28
30
31
32
33
34
35
36
H109
H115
H116
H117
H107
H119
H118
H105
H121
H120
H123
H122
H128
H127
H126
G122
G123
G124
G103
G112
G102
G100
G101
G115
G115F
M119
M111
M115
M105
M110
M109
J100
J101
32 ft

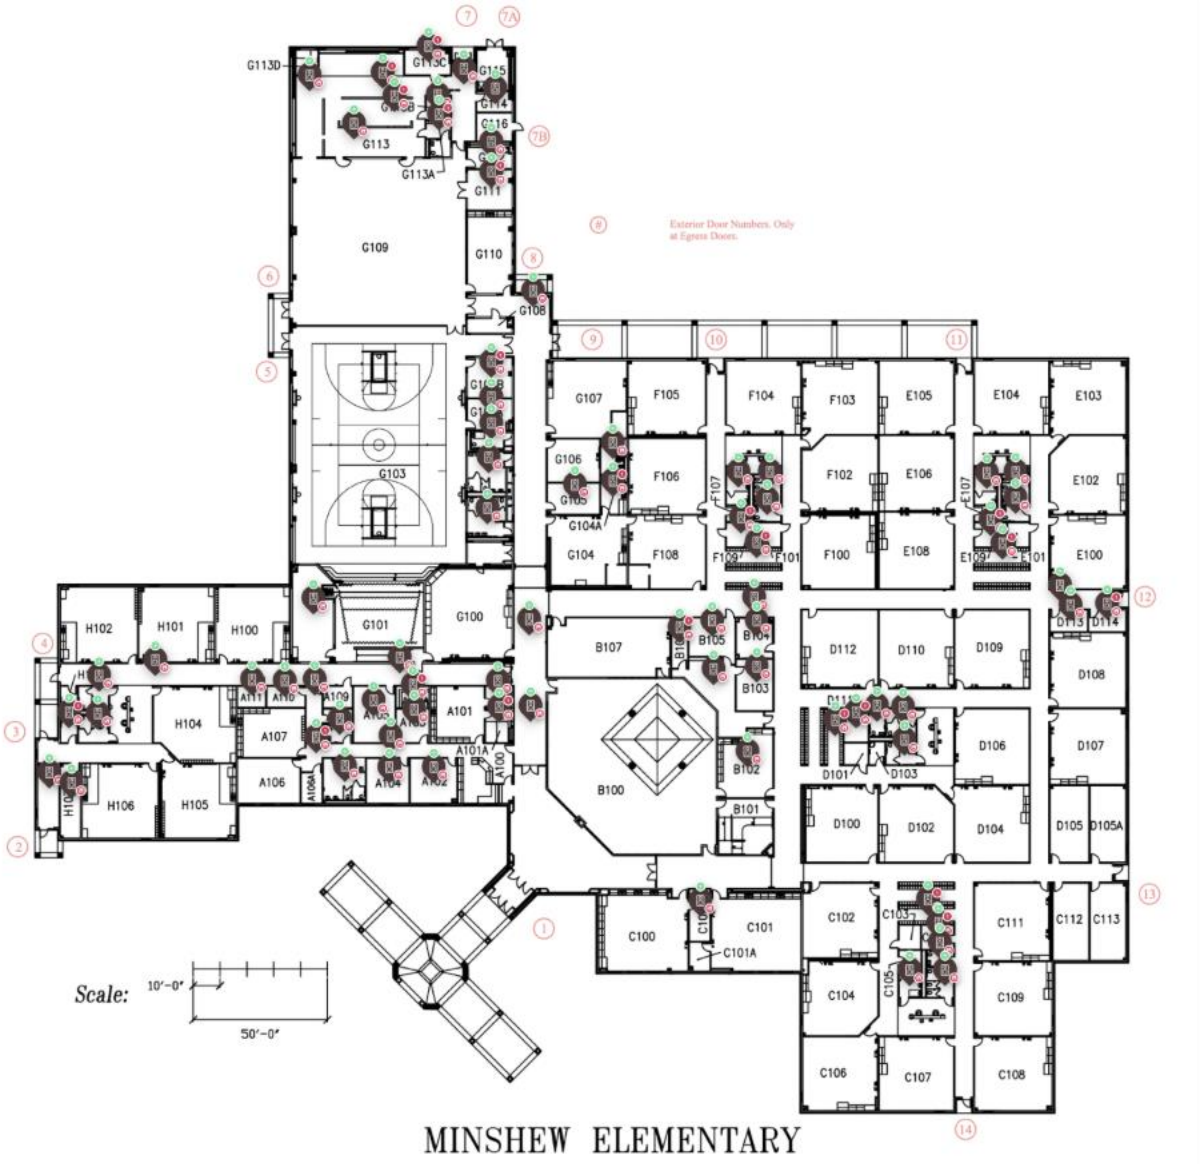

31
33
34
35
36
G122
G123
G103
G112
G102
H118
H120
H128
H127
H126
G100
G101
G115
G115F
M119
M111
M115
M105
M110
M109
M104
M101
J101
J107
J117
J116
J113
J115
K100
K101
K102
K113
K111
32 ft

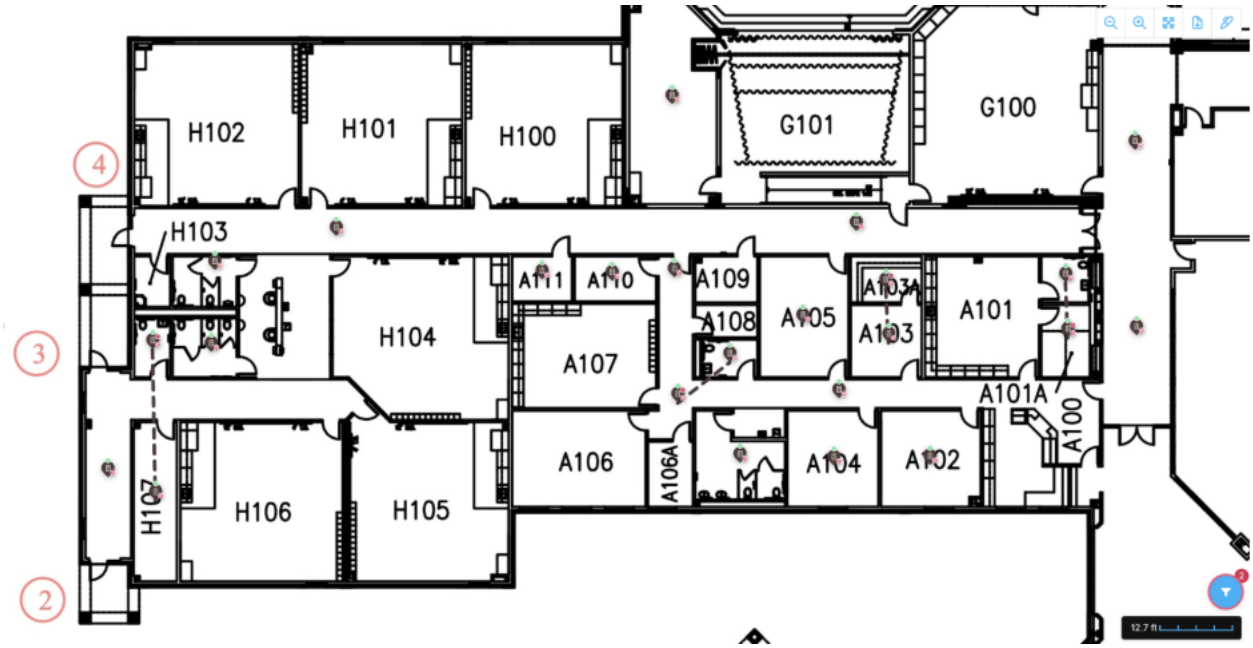
MCKINNEY BOYD HIGH SCHOOL FLOOR 2

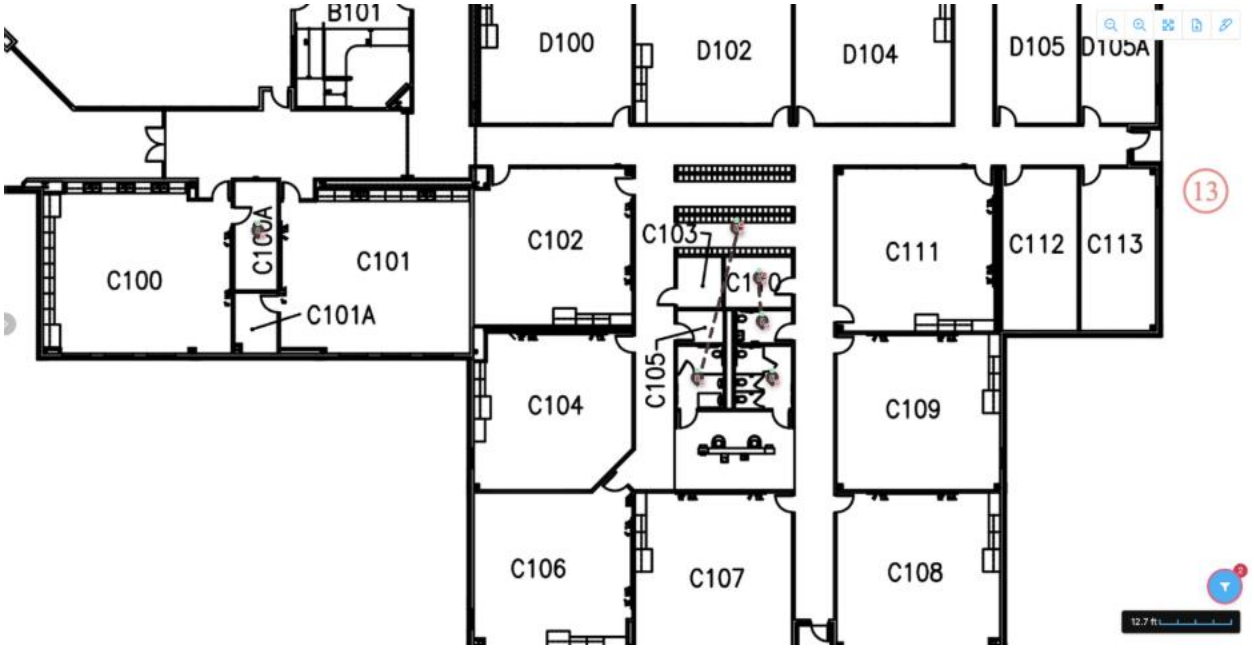




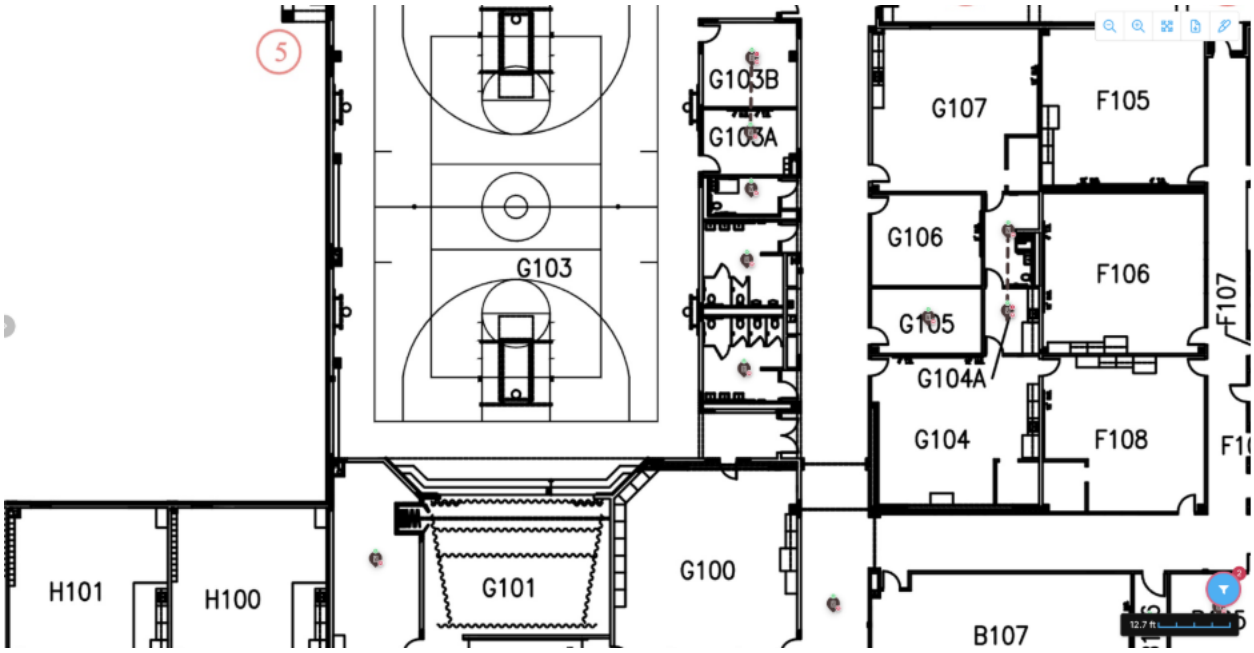
MINSHEW ELEMENTARY

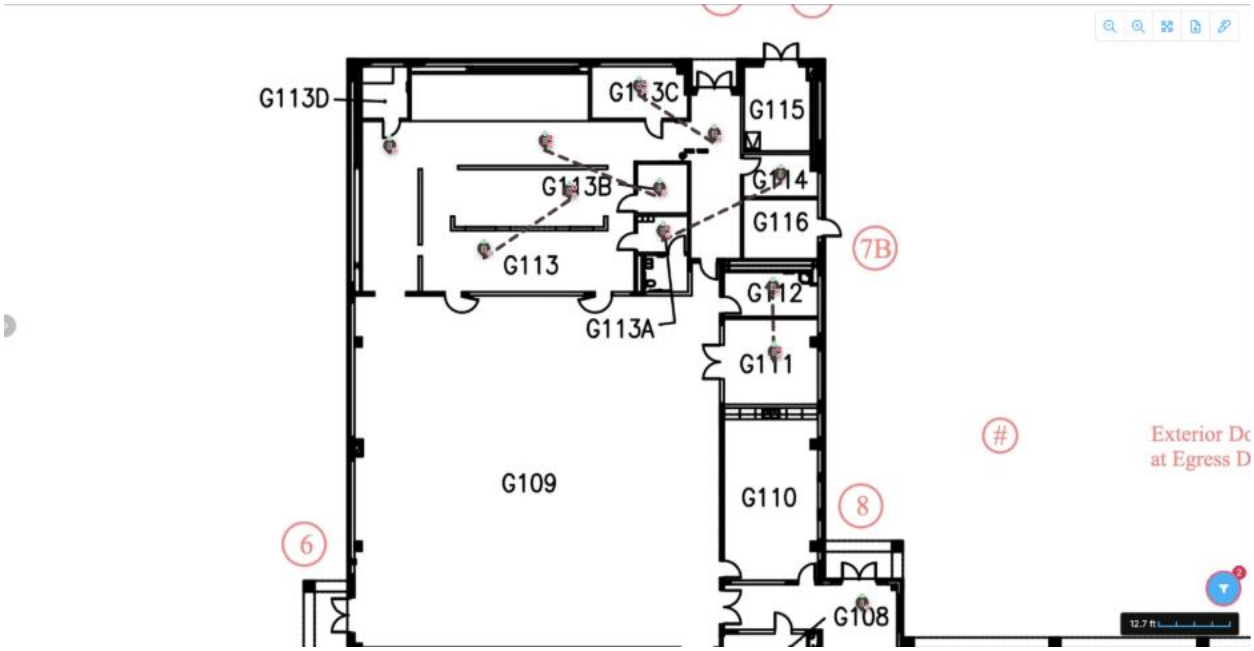



H102
H101
H100
G101
G100
4
H103
H104
A111
A110
A109
A108
A105
A103A
A103
A101
A107
A101A
A100
3
H107
H106
H105
A106
A106A
A104
A102
2


B101
D100
D102
D104
D105
D105A
13
C100
C100A
C101
C101A
C102
C103
C110
C111
C112
C113
C104
C105
C109
C106
C107
C108


B107
B106
B105
B104
B103
B102
B101
B100
D112
D110
D109
D111
D101
D103
D106
D100
D102
D104
D113
D114
D108
D107
D105
D105A
9
10
11
G107
F105
F104
F103
E105
E104
E103
G106
F106
G105
G104A
G104
F108
F107
F109
F101
F102
E106
F100
E108
E107
E109
E101
E102
E100





Nov 17, 2026 9:50 AM

4. E-Rate_Category_2_(Addendum_#1_Revision) Document

Nov 2, 2026 8:51 AM

Question: Page 41 lists items to support Badge Readers, DPI Sensors and Lockdown buttons. Please provide drawings indicating their end device locations, or provide and estimated distance for Cable & Supports allocation.

Nov 2, 2026 8:51 AM

Answered by Laura Duree: Badge readers, DPI Sensor, & Lockdown Button Locations will be provided in an addendum.

MCKINNEY BOYD HIGH SCHOOL FLOOR 1

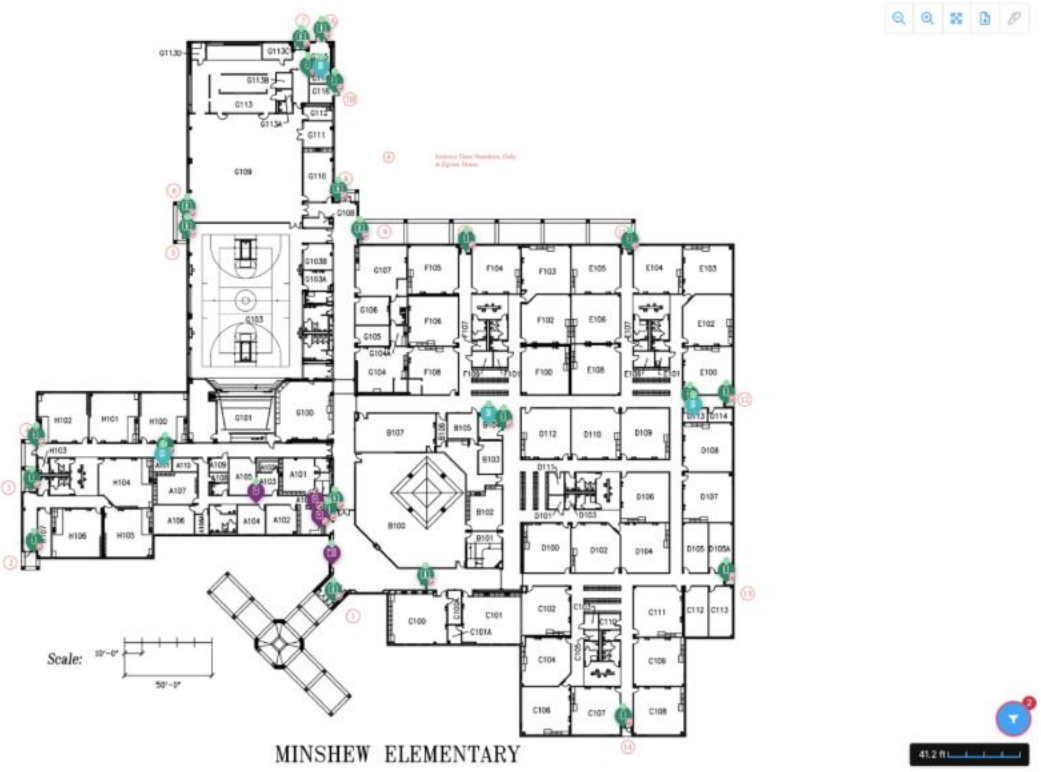


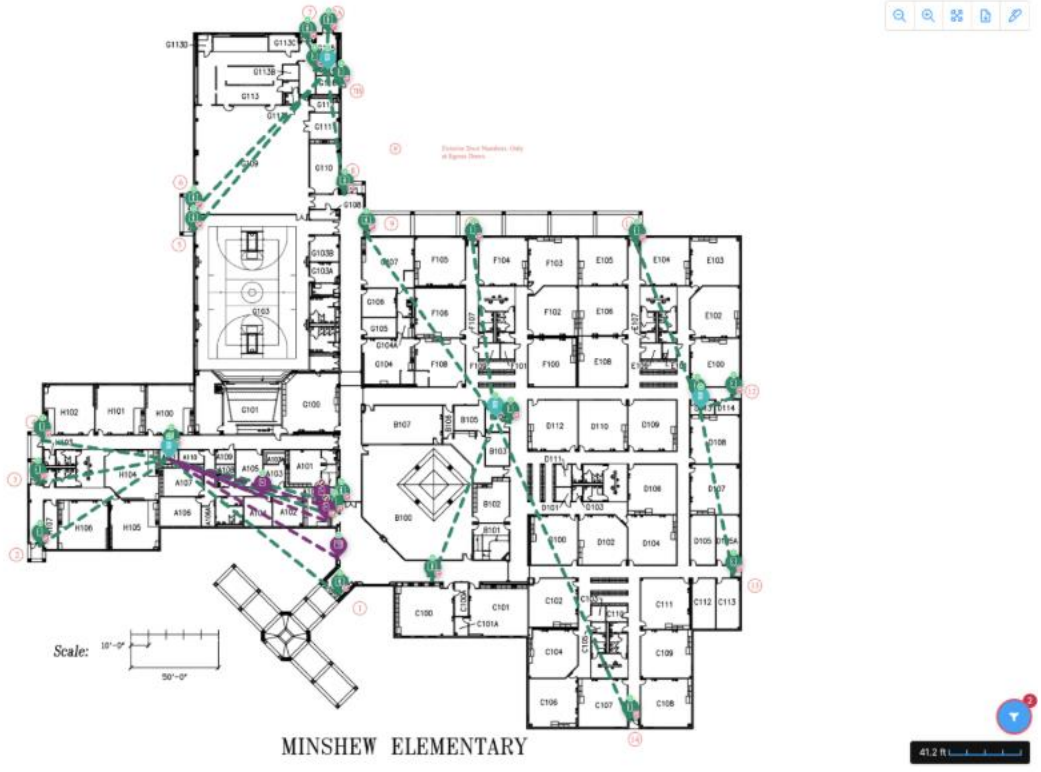


MCKINNEY BOYD HIGH SCHOOL FLOOR 2



MINSHEW ELEMENTARY


Scale:
MINSHEW ELEMENTARY


Scale:
MINSHEW ELEMENTARY


H102
H101
H100
G101
G100
B107
H103
A110
A109
A108
A105
A103A
A103
A101
H104
A107
A101A
A100
B100
A106
A106A
A104
A102
H107
H106
H105
4
3
2
1
C100
B107
B106
B105
B104
B103
B102
B101
B100
D112
D110
D109
D111
D101
D103
D106
D100
D102
D104
D113
D114
D108
D107
D105
D105A
13
C100
C100A
C101
C101A
C102
C103
C110
C111
C112
C113
C104
C105
C109
C106
C107
C108



Nov 17, 2026 9:50 AM

5. E-Rate_Category_2_(Addendum_#1_Revision) Document

Nov 2, 2026 8:51 AM

Question: Please confirm that we need to include (1) 24-Strand fiber from the MDF to each of the identified IDF's at Minshew ES & Boyd HS Phase 3

Nov 2, 2026 8:51 AM

Answered by Stephen McGilvray: Yes. Please refer to 3.14. STRUCTURED CABLING SPECIFICATIONS, INSTALLATION SPECIFICATIONS, bullet C.

Nov 17, 2026 9:50 AM

6. E-Rate_Category_2_(Addendum_#1_Revision) Document

Nov 2, 2026 8:52 AM

Question: Please confirm the AT&T Dmarc Location shown on Page 11 of the supporting attachments is the only DMARC for Minshew ES for the requested Cat3 25 Pair Feeder Cable

Nov 2, 2026 8:52 AM

Answered by Stephen McGilvray: That is correct as per the documentation.

Nov 17, 2026 9:50 AM

7. E-Rate_Category_2_(Addendum_#1_Revision) Document, Page 39

Nov 2, 2026 8:52 AM

Question: Is there desired cable jacket colors for the required 18/2, 18/4 and composite cable? Is the cable to be Plenum or Riser Rated?

Nov 2, 2026 8:52 AM

Answered by Stephen McGilvray: Composite cable is yellow. 18/2 & 18/4 cable is white. The cable should be plenum rated.

Nov 17, 2026 9:50 AM

8. E-Rate_Category_2_(Addendum_#1_Revision) Document, Page 42, Line O

Nov 2, 2026 8:52 AM

Question: There are no mentioned requirements for sleeve pathways going into non-classroom rooms. Is it acceptable to utilize 1" minimum sized Sleeves for non-classroom rooms?

Nov 2, 2026 8:52 AM

Answered by Stephen McGilvray: No, we want the 2" sleeve for non-classroom rooms.

Nov 17, 2026 9:50 AM

9. E-Rate_Category_2_(Addendum_#1_Revision) Document, Page 42, Line N

Nov 2, 2026 8:53 AM

Question: Please confirm if Minshew ES has existing overhead cable tray that can be used for new horizontal category/fiber cabling.

Nov 2, 2026 8:53 AM

Answered by Stephen McGilvray: Typically, there is existing overhead cable tray that can be used, but if there is not, it needs to be included in your proposal.

Nov 17, 2026 9:50 AM

10. E-Rate_Category_2_(Addendum_#1_Revision) Document, Page 42, Line N

Nov 2, 2026 8:53 AM

Question: Please confirm if Boyd HS Phase 3 has existing overhead cable tray that can be used for new horizontal category/fiber cabling.

Nov 2, 2026 8:53 AM

Answered by Stephen McGilvray: Typically, there is existing overhead cable tray that can be used, but if there is not, it needs to be included in your proposal.

Nov 17, 2026 9:50 AM

11. E-Rate_Category_2_(Addendum_#1_Revision) Document, Page 42, Line N

Nov 2, 2026 8:53 AM

Question: The requirement states that if no cable tray exists, the proposer will install 4"x12" Cable tray. To ensure even bids from all participating vendors, can you please provide a drawing showing the desired routing and location for the tray for both schools?

Nov 2, 2026 8:53 AM

Answered by Stephen McGilvray: The desired cable pathway should follow the hallways and corridors for each school.

Nov 17, 2026 9:50 AM

12. E-Rate_Category_2_(Addendum_#1_Revision) Document, Page 32

Nov 2, 2026 8:53 AM

Question: The required patch cord breakdown does not account for a total of (2) Patch Cords per cable segment installed. Please confirm the patch cord requirements for both schools.

Nov 2, 2026 8:53 AM

Answered by Stephen McGilvray: In the patch cord section, Item A accounts for the patch cord in the MDF/IDF closet side for the switch ports. Items B-H accounts for the 2nd patch cord on the device side.

Nov 17, 2026 9:50 AM

13. E-Rate_Category_2_(Addendum_#1_Revision) Document, Page 32

Nov 2, 2026 8:54 AM

Question: For the MDF to IDF Backbone fiber cabling from the MDF to each IDF at Boyd HS, Please clarify on the intent to get cabling between floors.

Nov 2, 2026 8:54 AM

Answered by Stephen McGilvray: The network closets at Boyd HS - Phase 3 have existing pathways between floors. The new cabling will run within these pathways.

Nov 17, 2026 9:50 AM

14. E-Rate_Category_2_(Addendum_#1_Revision) Document, Page 32

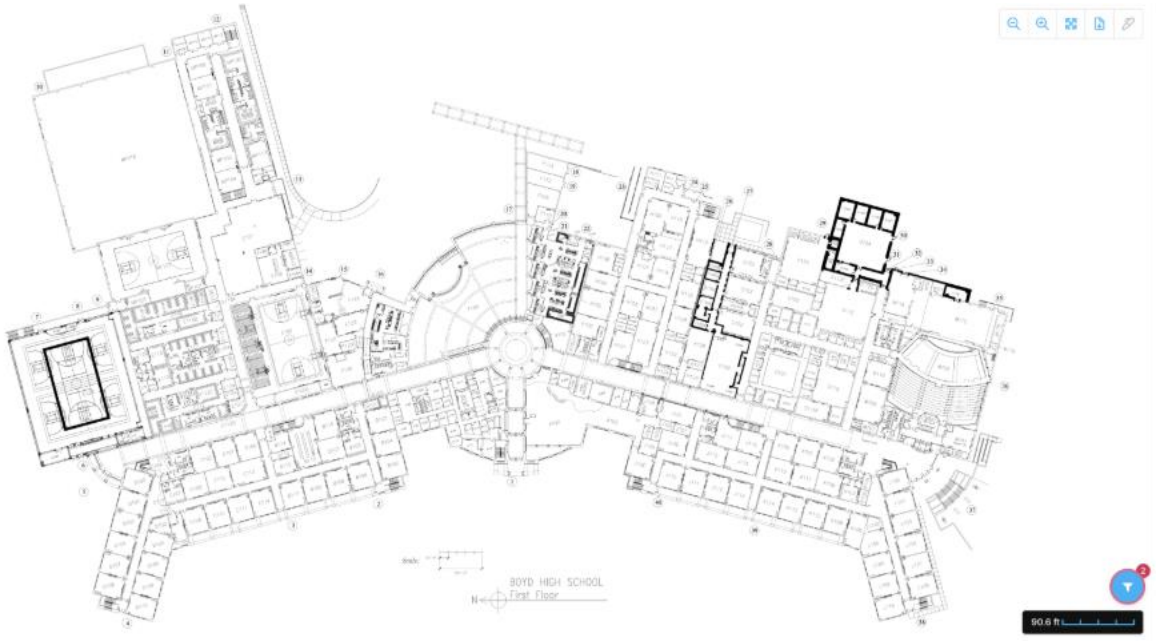
Nov 2, 2026 8:54 AM

Question: Can you provide a to-scale overall drawing for each floor at Boyd HS to accurately calculate backbone fiber footages?

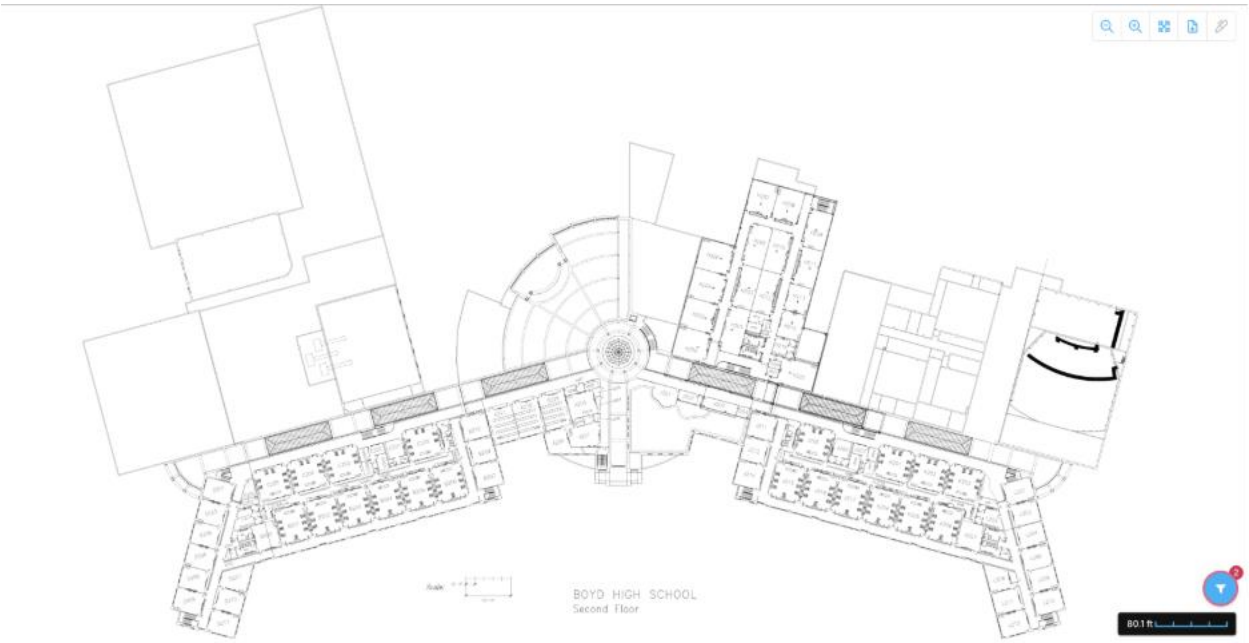
Nov 2, 2026 8:54 AM

Answered by Stephen McGilvray: Refer to the addendum section: FLOOR PLANS

MCKINNEY BOYD HIGH SCHOOL FLOOR 1:



MCKINNEY BOYD HIGH SCHOOL FLOOR 2:


BOYD HIGH SCHOOL
Second Floor
80.1 ft

MINSHEW ELEMENTARY



Nov 17, 2026 9:50 AM

15. E-Rate_Category_2_(Addendum_#1_Revision) Document, Page 32

Nov 2, 2026 8:54 AM

Question: Do we need to include demo of existing structured cabling or fiber at Minshew ES?

Nov 2, 2026 8:54 AM

Answered by Stephen McGilvray: No.

Nov 17, 2026 9:50 AM

16. E-Rate_Category_2_(Addendum_#1_Revision) Document, Page 32

Nov 2, 2026 8:55 AM

Question: Do we need to include any demo of existing structured cabling or fiber at Boyd HS?

Nov 2, 2026 8:55 AM

Answered by Stephen McGilvray: No.

Nov 17, 2026 9:50 AM

17. McKinney_ISD_E-Rate_Category_2_RFP_Supporting_Attachment, Page 11

Nov 2, 2026 8:55 AM

Question: The overhead ladder rack shown in Mindshew MDF B104 appears to have two different sizes. The approved material list only indicates 12". Please provide clarity on what size ladder rack is desired.

Nov 2, 2026 8:55 AM

Answered by Stephen McGilvray: All ladder rack should be 12".

Nov 17, 2026 9:50 AM

18. McKinney_ISD_E-Rate_Category_2_RFP_Supporting_Attachment, Page 11

Nov 2, 2026 8:55 AM

Question: Please confirm if we need to include any surface mount raceway or surface mounted conduit to support category 6A outlets.

Nov 2, 2026 8:55 AM

Answered by Stephen McGilvray: Surface mounted raceway or conduit should be included for network drops that are on cinderblock or brick walls that do not already have existing raceway or conduit.

Nov 17, 2026 9:50 AM

19. McKinney_ISD_E-Rate_Category_2_RFP_Supporting_Attachment, Page 11

Nov 2, 2026 8:56 AM

Question: Please clarify when work is allowed to be done. (During normal business Hours, Overnight, Weekends, School Break, Etc.)

Nov 2, 2026 8:56 AM

Answered by Stephen McGilvray: Project business hours are defined as 7:00 AM to 6:00 PM, weekdays, weekends, and holidays.

Nov 17, 2026 9:50 AM

20. McKinney_ISD_E-Rate_Category_2_RFP_Supporting_Attachment, Page 11

Nov 2, 2026 8:56 AM

Question: Please provide a breakdown of the Speaker, Strobe, Clock devices indicated on the cable Matrix Drop counts for each of the 2 schools.

Nov 2, 2026 8:56 AM

Answered by Stephen McGilvray: The speaker, strobe, and clock devices are all IP based and need a single Cat6A drop per the requested quantity in the matrix.

Nov 17, 2026 9:50 AM

21. McKinney_ISD_E-Rate_Category_2_RFP_Supporting_Attachment, Page 11

Nov 2, 2026 8:56 AM

Question: Please clarify who is responsible for providing and installing the telecommunications bonding busbar for each IDF/MDF room.

Nov 2, 2026 8:56 AM

Answered by Stephen McGilvray: The grounding bus bar for each MDF/IDF room will be installed by others.

Nov 17, 2026 9:50 AM

22. McKinney_ISD_E-Rate_Category_2_RFP_Supporting_Attachment, Page 11

Nov 2, 2026 8:57 AM

Question: Do we need to include any fiber patch cords to support the new 24-strand Singlemode fiber segments running to each IDF from the MDF room?

Nov 2, 2026 8:57 AM

Answered by Stephen McGilvray: The District will provide the fiber patch cords.

Nov 17, 2026 9:50 AM

23. McKinney_ISD_E-Rate_Category_2_RFP_Supporting_Attachment, Page 11

Nov 2, 2026 8:57 AM

Question: Can we use 24-Fiber, 12-Duplex LC Singlemode fiber adapter panels in lieu of (2) 12-Fiber, 6-Duplex LC Singlemode fiber adapter panels for each end of the fiber backbone cables?

Nov 2, 2026 8:57 AM

Answered by Stephen McGilvray: Yes.

Nov 17, 2026 9:50 AM

24. McKinney_ISD_E-Rate_Category_2_RFP_Supporting_Attachment, Page 11

Nov 2, 2026 8:57 AM

Question: Is it acceptable to provide pricing for a UPS/PDU Manufacturer other than APC?

Nov 2, 2026 8:57 AM

Answered by Stephen McGilvray: Yes.

Nov 17, 2026 9:50 AM

25. E-Rate_Category_2_(Addendum_#1_Revision) Document

Nov 2, 2026 8:52 AM

Question: Please confirm if we need to include labor to install owner furnished wall phones at all new outlet locations

Nov 2, 2026 8:52 AM

Answered by Stephen McGilvray: No

Nov 17, 2026 9:50 AM

26. 3.14. STRUCTURED CABLING SPECIFICATIONS

Nov 6, 2026 10:13 AM

Question: For the horizontal cabling, would you be open to giving Belden an opportunity to compete with Panduit on this project? We can offer a high-quality, reliable solution with competitive project pricing and strong product availability to help keep the project on schedule.

Nov 6, 2026 10:13 AM

Answered by Stephen McGilvray: The specifications list all Panduit items or equivalent. This is also referenced in the MCKINNEY ISD APPROVED PARTS LIST OR EQUIVALENT section. All equivalent manufacturer part numbers will be considered. Please provide specifications detailing how the part is equivalent to the part listed.

Nov 17, 2026 9:50 AM

27. No subject

Nov 12, 2026 10:50 AM

Question: For a company formed in 2026, may the three-year comparable-experience requirement be satisfied through the documented experience of the company's principal/owner and/or a named installation subcontractor, or must the proposing legal entity itself have three years of service history?

Nov 12, 2026 10:50 AM

Answered by Stephen McGilvray: The proposing legal entity must have three years of experience delivering comparable services of similar scope and complexity.

Nov 17, 2026 9:50 AM

28. No subject

Nov 12, 2026 10:50 AM

Question: Must the proposer's SPIN (FCC Form 498 ID) be active at proposal submission (December 11, 2026), or will the District accept a proposer whose Form 498 has been filed with USAC and whose SPIN is pending issuance, provided it is active before award/invoicing?

Nov 12, 2026 10:50 AM

Answered by Stephen McGilvray: Section 2.1 in the Proposer Submissions requires respondents to provide their FCC Registration Number (FRN) and E-Rate Service Provider Identification Number (SPIN / FCC Form 498 ID) at the time of submission. Proposals that omit required information may be deemed non-responsive per Section 2.3 of the Proposal Instructions.

Nov 17, 2026 9:50 AM

29. No subject

Nov 12, 2026 10:50 AM

Question: If a proposer cannot supply three current school-district customers, may references be the principal's prior-project references from previous employment, or customers of a named subcontractor?

Nov 12, 2026 10:50 AM

Answered by Laura Duree: References should be for the proposing firm. If the proposer is unable to provide three current school district customers, the proposer may provide three current customer references as permitted by the solicitation. References from previous employers of key personnel or from subcontractors do not satisfy the reference requirement for the proposing firm.

Nov 17, 2026 9:50 AM

30. No subject

Nov 12, 2026 10:51 AM

Question: Is a bid bond via Surety2000 required for a partial (structured-cabling-only) proposal, and if so, at what amount or percentage? For the 100% performance/payment bonds due on award, what equivalent financial assurances has the District accepted in the past?

Nov 12, 2026 10:51 AM

Answered by Laura Duree: For proposals including structured cabling work, a bid bond is required through Surety2000 as indicated in Section 1.6. The required bid security is 5% of the proposal amount. For performance and payment bond requirements that may be imposed upon award pursuant to Section 1.5, proposers unable to provide the required bond may submit proposed equivalent financial assurances for District review and approval in accordance with Section 1.5.1 (available once "no" is selected on 1.5. The District may consider alternatives, including a cashier's check, as an equivalent financial assurance; however, acceptance is subject to District review and approval.

Nov 17, 2026 9:50 AM

31. No subject

Nov 12, 2026 10:50 AM

Question: For a newly formed company that cannot provide three fiscal years of audited financial statements, what alternative demonstration of financial capacity will the District accept (e.g., bank references, reviewed statements for the period since formation, owner financial statement)?

Nov 12, 2026 10:50 AM

Answered by Stacey Stanfield: Please provide audited financial statements for as many years as you have been in business. If you have been in business less than one year, please send the most current financials.

Nov 17, 2026 9:50 AM

32. No subject

Nov 12, 2026 10:51 AM

Question: If a proposal names an experienced installation subcontractor under a primary proposer, will the subcontractor's experience, references, and E-Rate compliance record be evaluated toward the Section 3.7 minimum qualifications?

Nov 12, 2026 10:51 AM

Answered by Stephen McGilvray: No, the subcontractor's experiences, references, and E-Rate compliance record will not meet requirements for this RFP.

Nov 17, 2026 9:50 AM

33. No subject

Nov 12, 2026 10:51 AM

Question: Will the District hold any additional cabling site visits before December 11 for proposers who did not attend the November 5-6 visits, or is site-visit attendance closed?

Nov 12, 2026 10:51 AM

Answered by Debbie Paulsen: There will be no additional site visit held.

Nov 17, 2026 9:50 AM

34. Battery packs per UPS

Nov 12, 2026 3:34 PM

Question: The pricing form lists 200 UPS units (22 × SRTL3KRM1UNC and 178 × SRTL2K2RM1UNC) and 600 external battery packs (SRTL50RMBP1U-LI). Please confirm that the District intends three external battery packs per UPS at every location. If the count varies by site or closet, please give the quantity per UPS model or per location.

Nov 12, 2026 3:34 PM

Answered by Stephen McGilvray: On average, each UPS will have (3) battery packs connected. Smaller network closets with 1-2 switches have two battery packs, closets with 3-4 switches have three battery packs, closets with 5-6 switches have four battery packs, and closets with 7+ switches have 5 battery packs.

Nov 17, 2026 9:50 AM

35. UPS runtime

Nov 12, 2026 3:35 PM

Question: What runtime is the District looking for at each closet, and at roughly what load (watts or percentage of UPS capacity)?

Nov 12, 2026 3:35 PM

Answered by Stephen McGilvray: Based on the switch counts per closet mentioned above, the District targets one hour runtime based on the historical load.

Nov 17, 2026 9:50 AM

36. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:34 PM

Question: There is no call out for cabinets in the MDF?

Nov 13, 2026 2:34 PM

Answered by Stephen McGilvray: No, the MDF was renovated as part of Phase 2. Only SM fiber running from the MDF to the IDF locations are included in the phase 3 project.

Nov 17, 2026 9:50 AM

37. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:35 PM

Question: What type of fiber is in here already?

Nov 13, 2026 2:35 PM

Answered by Stephen McGilvray: 24 Strand Fiber Cable, OS2, Indoor Armored, Plenum, 900µm Single-mode

Nov 17, 2026 9:50 AM

38. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:35 PM

Question: Are we responsible for the removal of the old stuff?

Nov 13, 2026 2:35 PM

Answered by Stephen McGilvray: No, this proposal only covers the new installation covered in the RFP.

Nov 17, 2026 9:50 AM

39. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:35 PM

Question: We will just be pulling new cables?

Nov 13, 2026 2:35 PM

Answered by Stephen McGilvray: Yes, along with the build out of the network closet items covered in the RFP.

Nov 17, 2026 9:50 AM

40. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:36 PM

Question: How familiar are we with the pathways in the building?

Nov 13, 2026 2:36 PM

Answered by Stephen McGilvray: Somewhat familiar, but the ceiling tiles will be completely removed to expose all pathways.

Nov 17, 2026 9:50 AM

41. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:36 PM

Question: Are we going to stick to existing pathways, or new pathways?

Nov 13, 2026 2:36 PM

Answered by Stephen McGilvray: Existing pathways, when possible, but new pathways can be created if it is accounted for in your proposal.

Nov 17, 2026 9:50 AM

42. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:36 PM

Question: Will the existing cable already be pulled out when we start running the new cable?

Nov 13, 2026 2:36 PM

Answered by Stephen McGilvray: Yes, all old cabling will be removed before the new cable is run.

Nov 17, 2026 9:50 AM

43. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:37 PM

Question: Are we keeping the existing racks from the IDF's?

Nov 13, 2026 2:37 PM

Answered by Stephen McGilvray: All proposals need to include new racks to keep all bids consistent.

Nov 17, 2026 9:50 AM

44. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:37 PM

Question: Are bidders responsible for removing all existing cables?

Nov 13, 2026 2:37 PM

Answered by Stephen McGilvray: No, that will be handled separately from this proposal.

Nov 17, 2026 9:50 AM

45. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:37 PM

Question: Would you like bidders to have an alternate proposal to remove the existing cable?

Nov 13, 2026 2:37 PM

Answered by Stephen McGilvray: No, there will be another opportunity to provide proposals for the removal of the existing cable.

Nov 17, 2026 9:50 AM

46. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:38 PM

Question: Will everything in this room be gutted?

Nov 13, 2026 2:38 PM

Answered by Stephen McGilvray: Yes

Nov 17, 2026 9:50 AM

47. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:38 PM

Question: Where are the cinderblock walls in the building?

Nov 13, 2026 2:38 PM

Answered by Stephen McGilvray: There are cinderblock walls in most parts of the building, but it is not every wall.

Nov 17, 2026 9:50 AM

48. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:38 PM

Question: Is there cinderblock between classrooms?

Nov 13, 2026 2:38 PM

Answered by Stephen McGilvray: Yes, in some classroom spaces there may be cinderblock.

Nov 17, 2026 9:50 AM

49. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:39 PM

Question: Can we see inside a classroom?

Nov 13, 2026 2:39 PM

Answered by Stephen McGilvray: Yes, any classroom that is open can be looked at.

Nov 17, 2026 9:50 AM

50. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:39 PM

Question: Data cables for the TVs, I assume each one is getting a data cable?

Nov 13, 2026 2:39 PM

Answered by Stephen McGilvray: No, we are moving them to wireless.

Nov 17, 2026 9:50 AM

51. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:39 PM

Question: I was asking to see if we needed to take the TV down?

Nov 13, 2026 2:39 PM

Answered by Stephen McGilvray: No, the TVs and other technology items will already be removed before cabling install.

Nov 17, 2026 9:50 AM

52. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:40 PM

Question: Access points and cameras, are we responsible for taking those down?

Nov 13, 2026 2:40 PM

Answered by Stephen McGilvray: No, these and other technology items will already be removed before cabling install.

Nov 17, 2026 9:50 AM

53. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:40 PM

Question: When we pull cables to the APs and cameras, are we responsible for patching them in on the device side?

Nov 13, 2026 2:40 PM

Answered by Stephen McGilvray: The devices should not be installed before the new cabling is pulled. If the timeline of the project gets off and the device is installed before the cabling is run, we would like it to be connected to the device.

Nov 17, 2026 9:50 AM

54. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:40 PM

Question: How often do you refresh schools?

Nov 13, 2026 2:40 PM

Answered by Stephen McGilvray: A 20-year cycle

Nov 17, 2026 9:50 AM

55. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:40 PM

Question: What year was the building built?

Nov 13, 2026 2:40 PM

Answered by Stephen McGilvray: 2006

Nov 17, 2026 9:50 AM

56. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:41 PM

Question: Will there be someone from the district in charge, or will there be a GC?

Nov 13, 2026 2:41 PM

Answered by Stephen McGilvray: A member of our facilities team will act as a GC but it is an MISD employee. We follow their schedule for when things can be done in a section of the building.

Nov 17, 2026 9:50 AM

57. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:41 PM

Question: Would bidder be able to put a storage container out onsite before the project starts?

Nov 13, 2026 2:41 PM

Answered by Stephen McGilvray: Yes

Nov 17, 2026 9:50 AM

58. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:41 PM

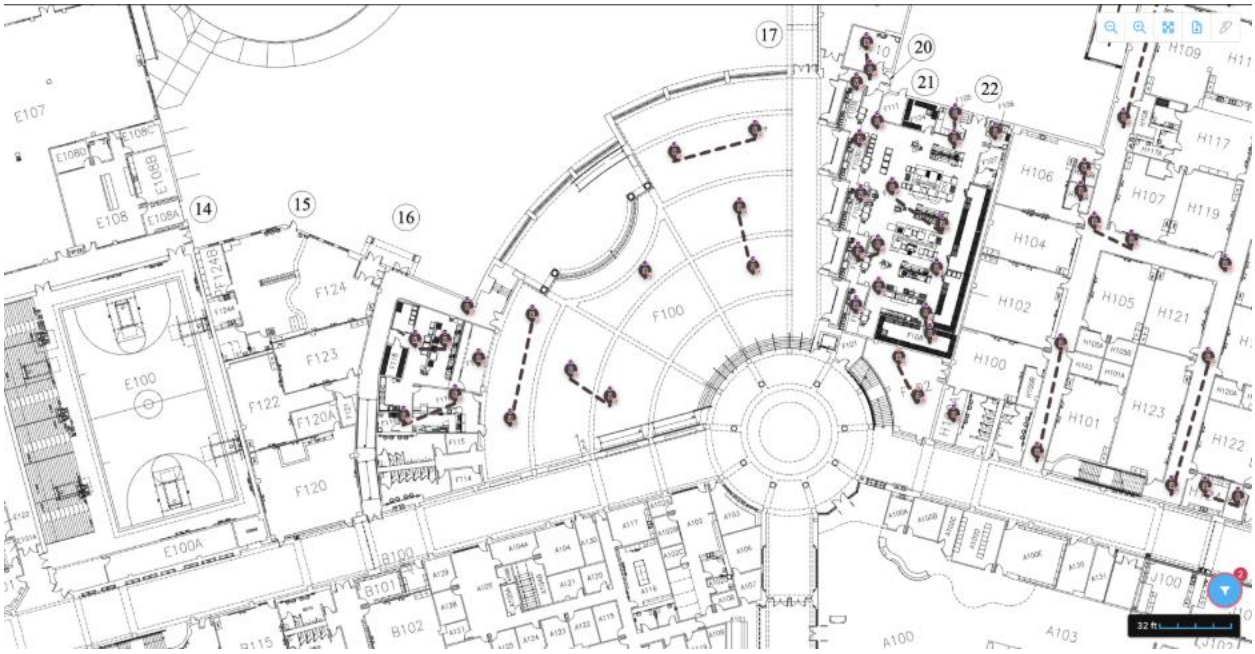
Question: Where are the speakers drops and extension speakers going?

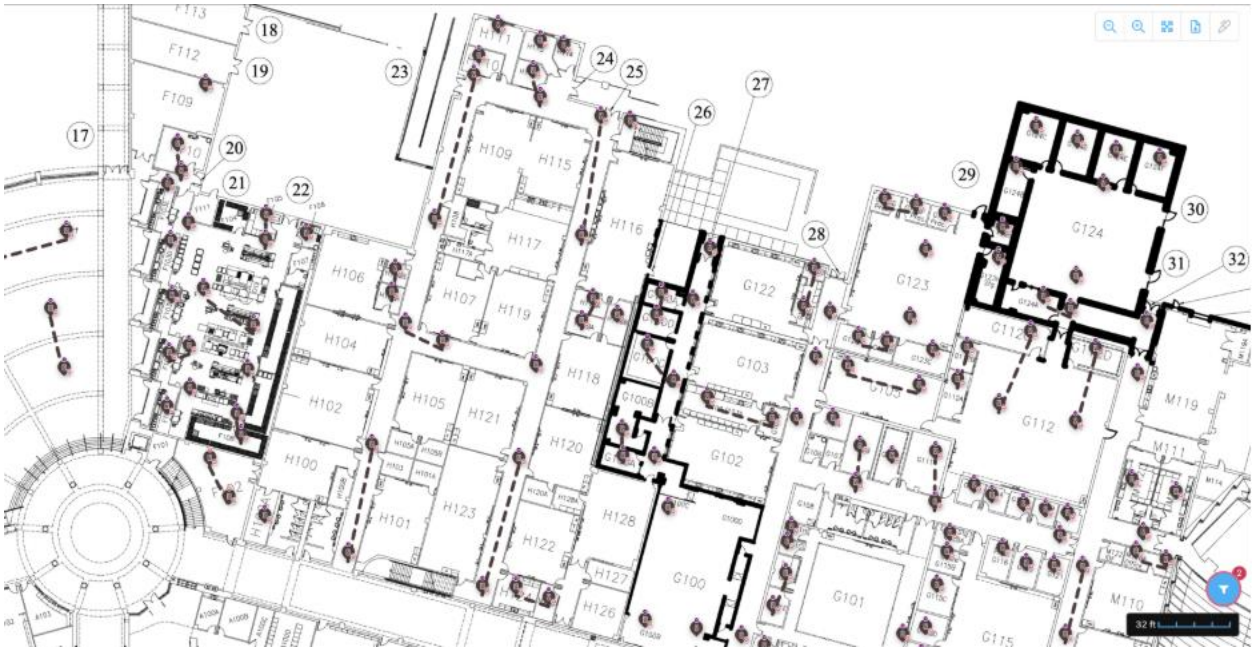
Nov 13, 2026 2:41 PM

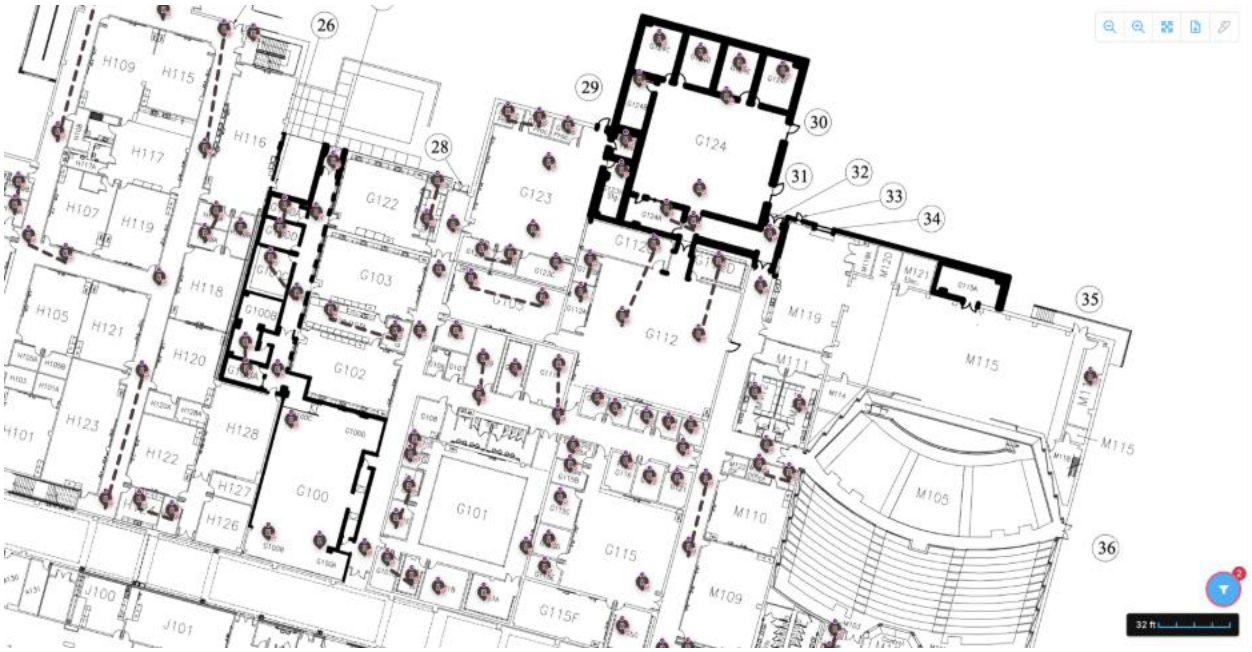
Answered by Laura Duree: The speaker & extension speaker locations will be provided in an addendum.

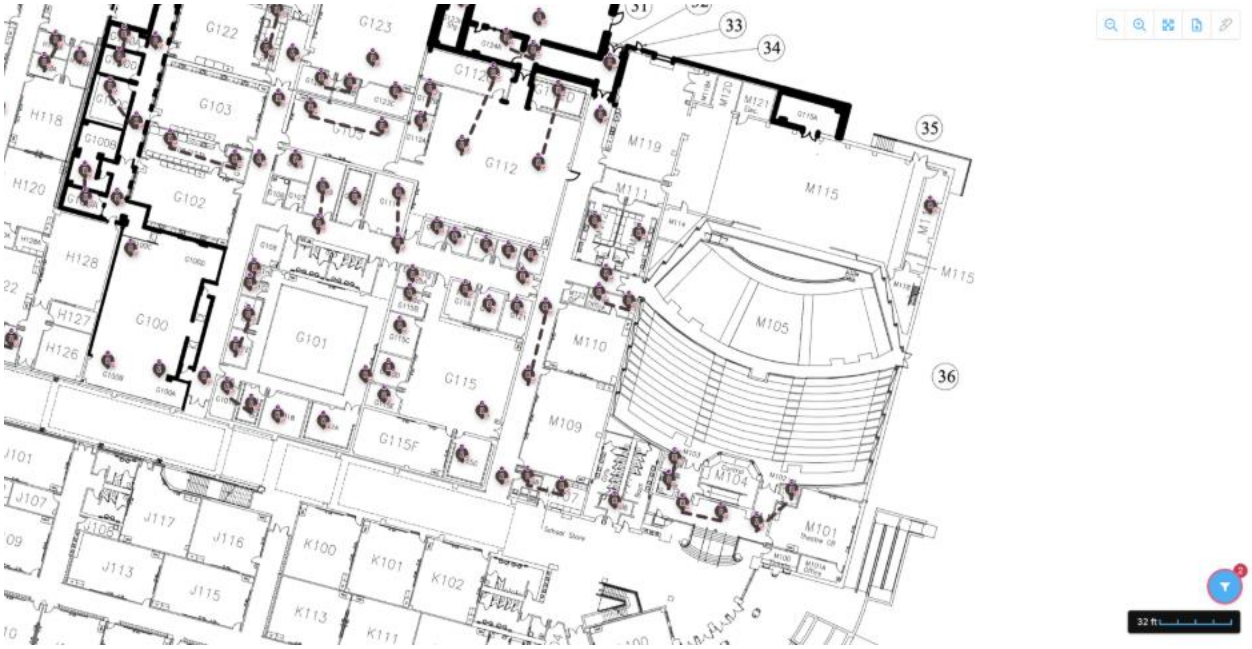
MCKINNEY BOYD HIGH SCHOOL FLOOR 1:




17
20
21
22
14
15
16
E107
E108
E100
E100A
F124
F123
F122
F120A
F120
F100
H106
H107
H119
H104
H102
H105
H121
H100
H101
H123
H122
B100
B101
B102
A100
A103
32 ft


18
19
23
24
25
27
26
17
20
21
22
29
30
31
32
28
F112
F109
H109
H115
H116
H117
H107
H119
H106
H104
H102
H105
H121
H120
H118
H100
H101
H123
H122
H128
H127
H126
G122
G123
G124
G103
G102
G112
G100
G101
M119
M111
M110
G115
32 ft


26
29
28
30
31
32
33
34
35
36
H109
H115
H116
H117
H107
H119
H118
H105
H121
H120
H123
H122
H128
H127
H126
H101
J100
J101
G122
G123
G124
G103
G102
G100
G101
G112
G115
G115F
M119
M111
M115
M105
M110
M109
32 ft

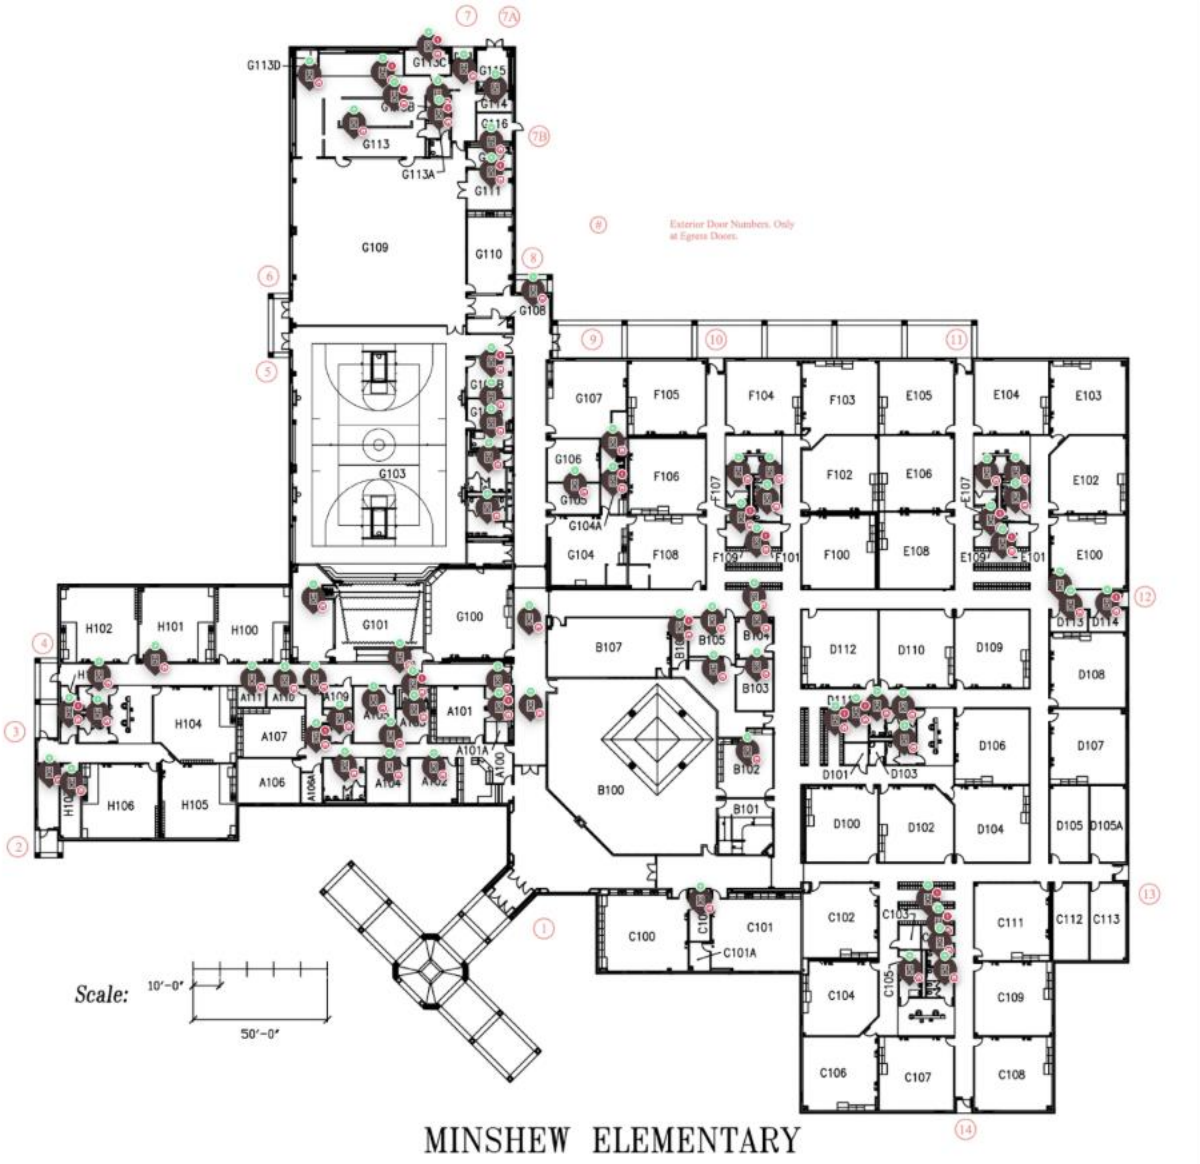

31
33
34
35
36
G122
G123
G103
G112
G102
G100
G101
G115
G115F
M119
M111
M115
M105
M110
M109
M104
M101
H118
H120
H128
H127
H126
J101
J107
J117
J116
J113
J115
K100
K101
K102
K113
K111
32 ft

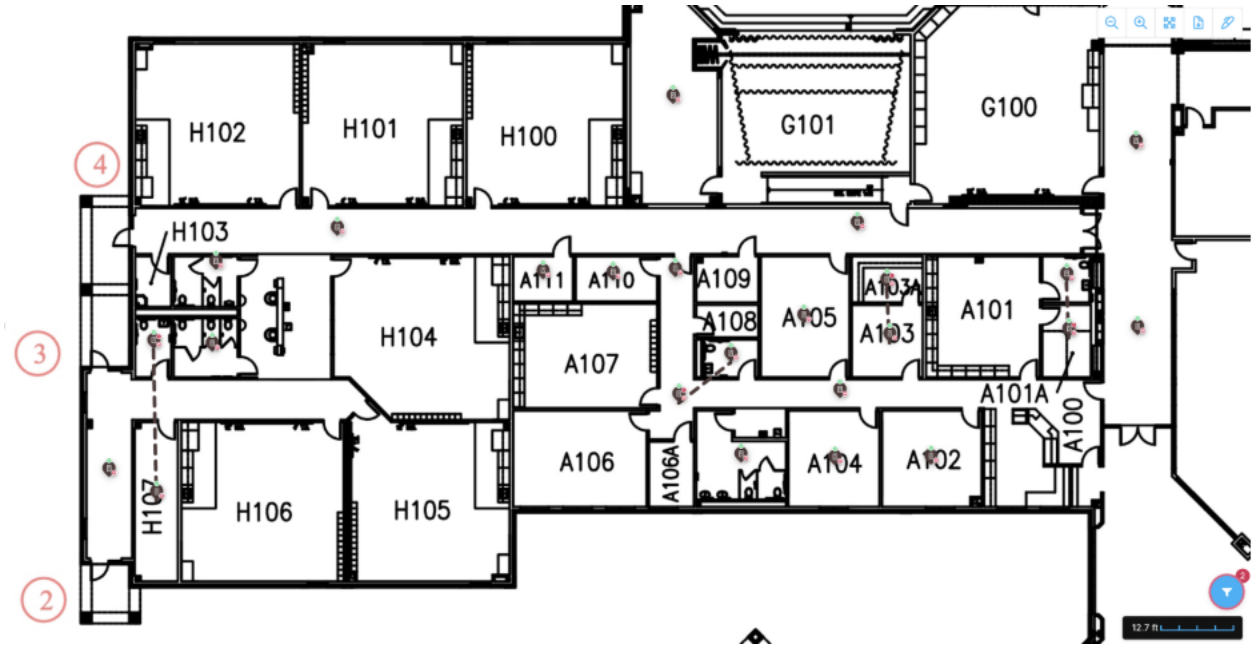
MCKINNEY BOYD HIGH SCHOOL FLOOR 2

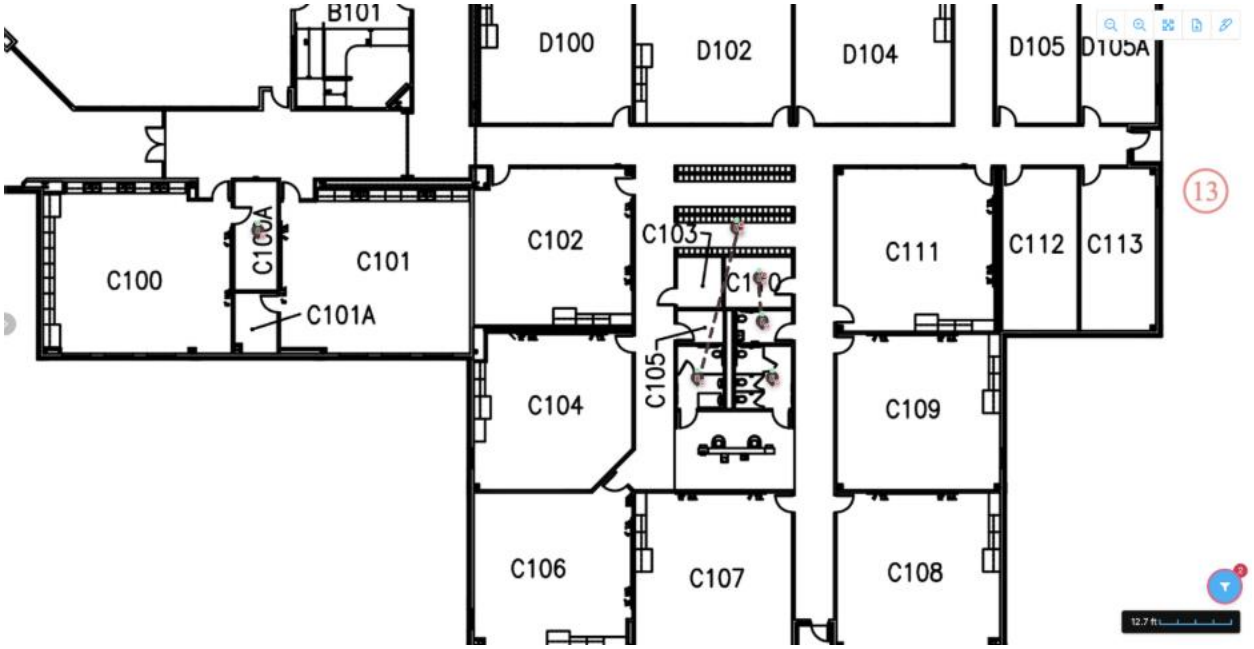




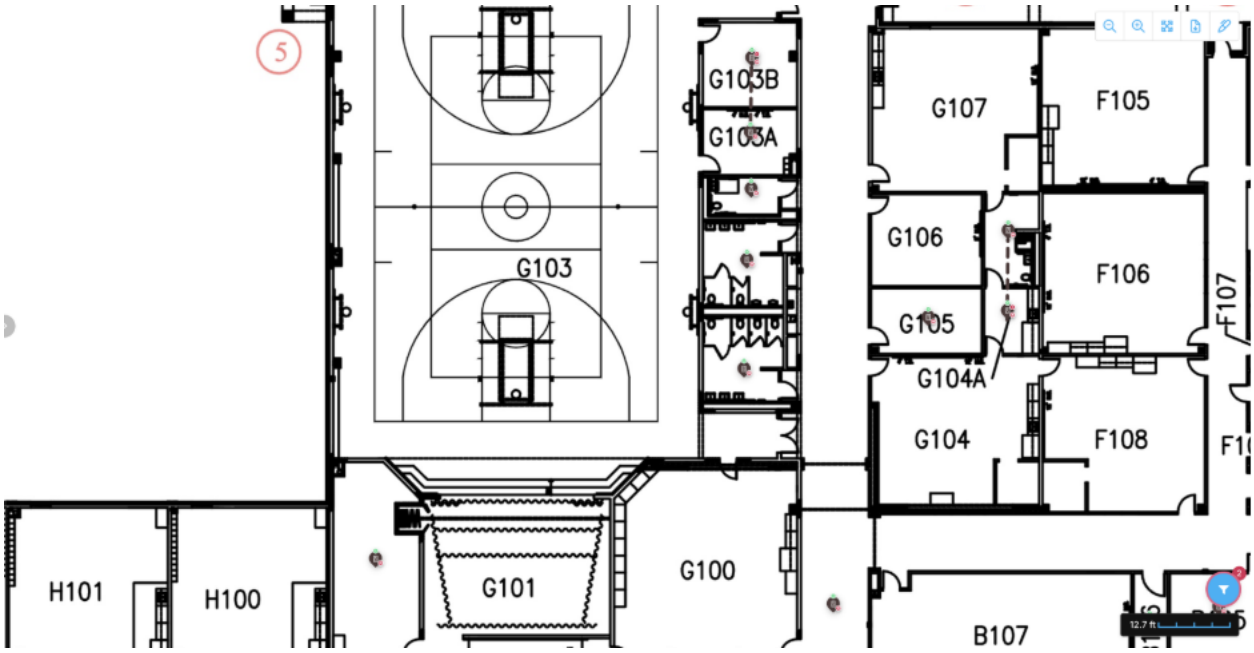
MINSHEW ELEMENTARY

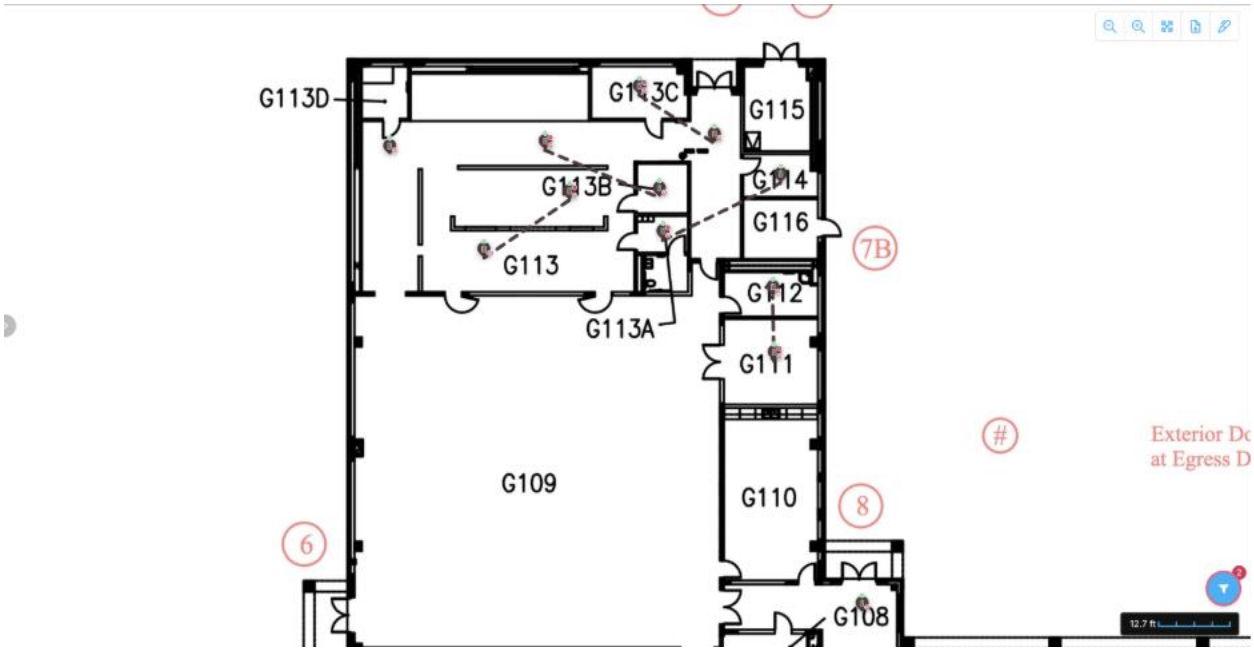



H102
H101
H100
G101
G100
4
H103
A111
A110
A109
A108
A105
A103A
A103
A101
H104
A107
A101A
A100
3
H107
H106
H105
A106
A106A
A104
A102
2


B101
D100
D102
D104
D105
D105A
13
C100
C100A
C101
C101A
C102
C103
C110
C111
C112
C113
C104
C105
C109
C106
C107
C108


B107
B106
B105
B104
B103
B102
B101
B100
D112
D110
D109
D111
D101
D103
D106
D100
D102
D104
D113
D114
D108
D107
D105
D105A
9
10
11
G107
F105
F104
F103
E105
E104
E103
G106
F106
G105
G104A
G104
F108
F107
F109
F101
F102
E106
F100
E108
E107
E109
E101
E102
E100





Nov 17, 2026 9:50 AM

59. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:42 PM

Question: The speaker cables are the only non-ethernet cables being installed?

Nov 13, 2026 2:42 PM

Answered by Stephen McGilvray: No, the access-controlled doors will need composite cables. There are other doors that are DPI sensor only that will not need the full composite cable but will need the 18/4 cable. The door locations will be provided in an addendum.

MCKINNEY BOYD HIGH SCHOOL FLOOR 1



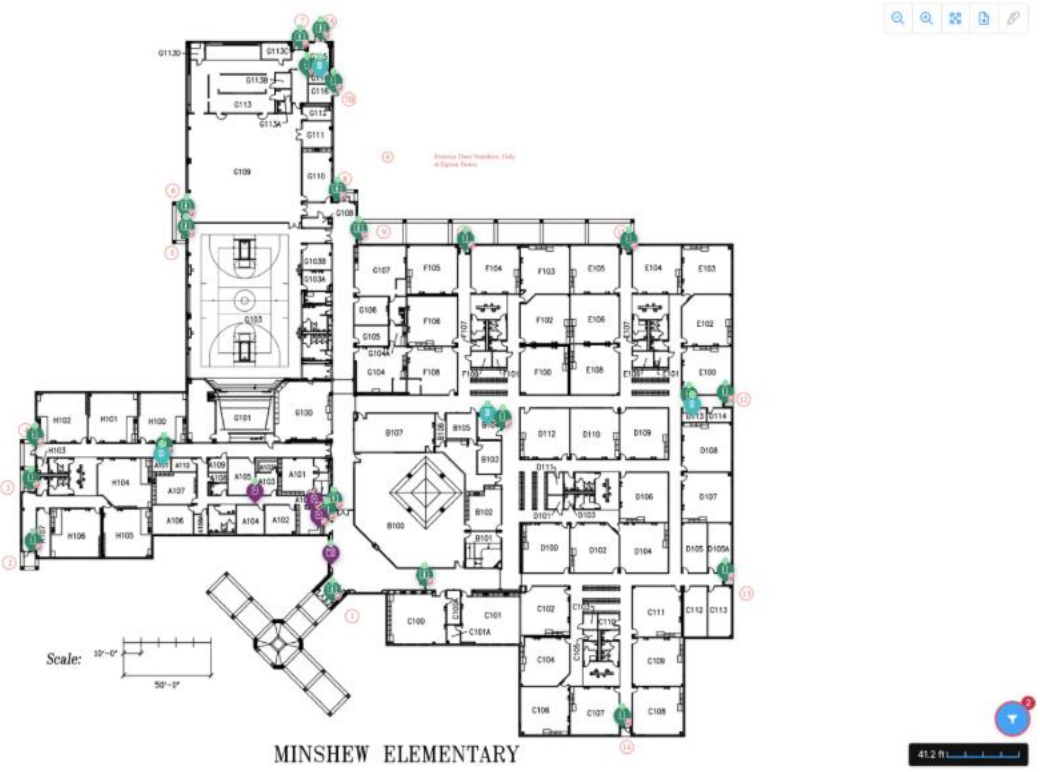


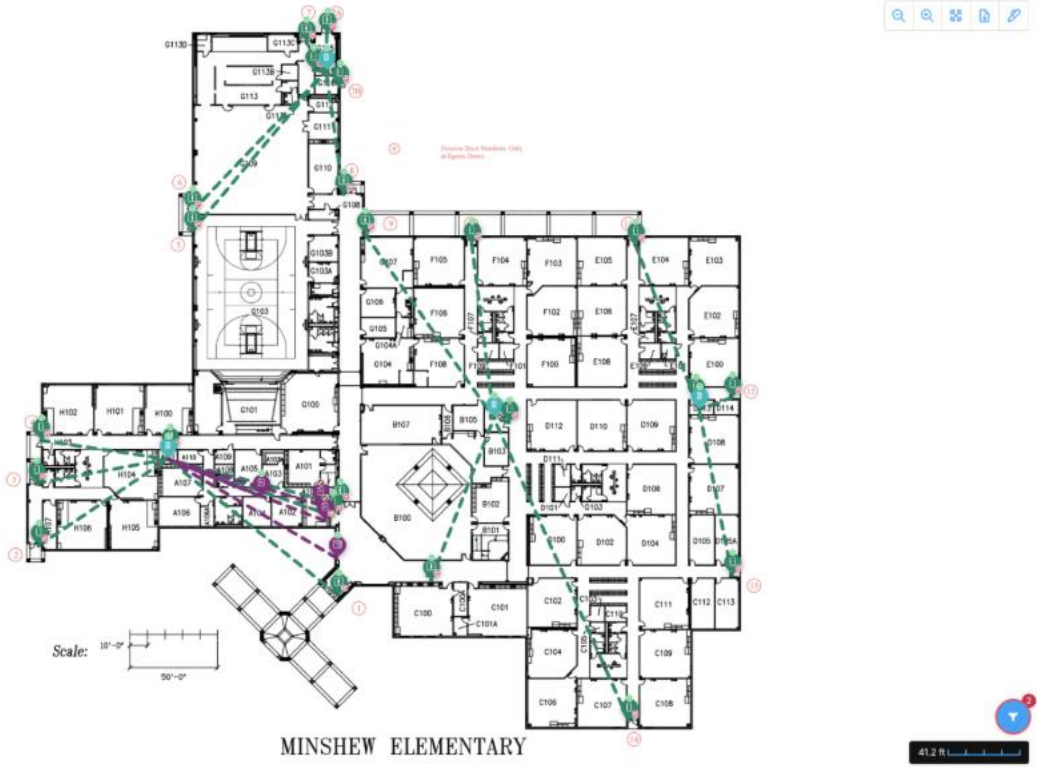


MCKINNEY BOYD HIGH SCHOOL FLOOR 2



MINSHEW ELEMENTARY


Scale:
MINSHEW ELEMENTARY
41.2 ft


Scale:
MINSHEW ELEMENTARY
41.2 ft


H102
H101
H100
G101
G100
B107
H103
A110
A109
A108
A105
A103A
A103
A101
H104
A107
A101A
A100
B100
A106
A106A
A104
A102
H107
H106
H105
4
3
2
1
C100
B107
B106
B105
B104
B103
B102
B101
B100
D112
D110
D109
D111
D101
D103
D106
D100
D102
D104
D113
D114
D108
D107
D105
D105A
13
C100
C100A
C101
C101A
C102
C103
C110
C111
C112
C113
C104
C105
C109
C106
C107
C108



Nov 17, 2026 9:50 AM

60. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:42 PM

Question: For the IDFs are bidders proposing the wall cabinet, 2 post racks ,etc.?

Nov 13, 2026 2:42 PM

Answered by Stephen McGilvray: Yes, the bid will need to include a full buildout, as if there was no existing hardware.

Nov 17, 2026 9:50 AM

61. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:42 PM

Question: Are bidders re-cabling access control and reconnecting those doors?

Nov 13, 2026 2:42 PM

Answered by Stephen McGilvray: Bidders are only getting the specified cable in the BOM to the location of the door, speaker, DPI sensor, etc. The installation of the speakers, access points, etc. are not part of this proposal.

Nov 17, 2026 9:50 AM

62. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:43 PM

Question: Has the proposal for installation of the technology items already been sent out?

Nov 13, 2026 2:43 PM

Answered by Stephen McGilvray: No, it has not.

Nov 17, 2026 9:50 AM

63. Question from McKinney Boyd High School Pre-Proposal Site Visit

Nov 13, 2026 2:43 PM

Question: Will the separate proposals be sent out to those who respond to this bid? Or do they need to keep an eye out on the site for another post?

Nov 13, 2026 2:43 PM

Answered by Stephen McGilvray: We will make sure those opportunities are sent out to all responders.

Nov 17, 2026 9:50 AM

64. Question from Minshew Elementary Pre-Proposal Site Visit

Nov 13, 2026 2:44 PM

Question: Room D113 is being converted into an IDF?

Nov 13, 2026 2:44 PM

Answered by Stephen McGilvray: Yes, this is a storage closet today that will be converted to an IDF during the renovations.

Nov 17, 2026 9:50 AM

65. Question from Minshew Elementary Pre-Proposal Site Visit

Nov 13, 2026 2:44 PM

Question: Are bidders pulling security camera wiring and access control?

Nov 13, 2026 2:44 PM

Answered by Stephen McGilvray: Yes, this is for all cabling in the building.

Nov 17, 2026 9:50 AM

66. Question from Minshew Elementary Pre-Proposal Site Visit

Nov 13, 2026 2:44 PM

Question: Is there a basket tray for pathways?

Nov 13, 2026 2:44 PM

Answered by Stephen McGilvray: Typically yes, but if there is not, it needs to be included in your proposal.

Nov 17, 2026 9:50 AM