KELLOGG & SOVEREIGN CONSULTING

REQUEST FOR PROPOSAL - ADDENDUM 1
Question & Answer

Applicant	**Killeen Independent School District**
BEN	**141065**
Form 470 #	**270002748**
470 Description	**KISD 2027-C1 WAN**
Addendum #	**1**
Date Posted	**11/23/2026**
e-Bidding Link	https://kellogglc.bonfirehub.com/portal

Questions and Answers

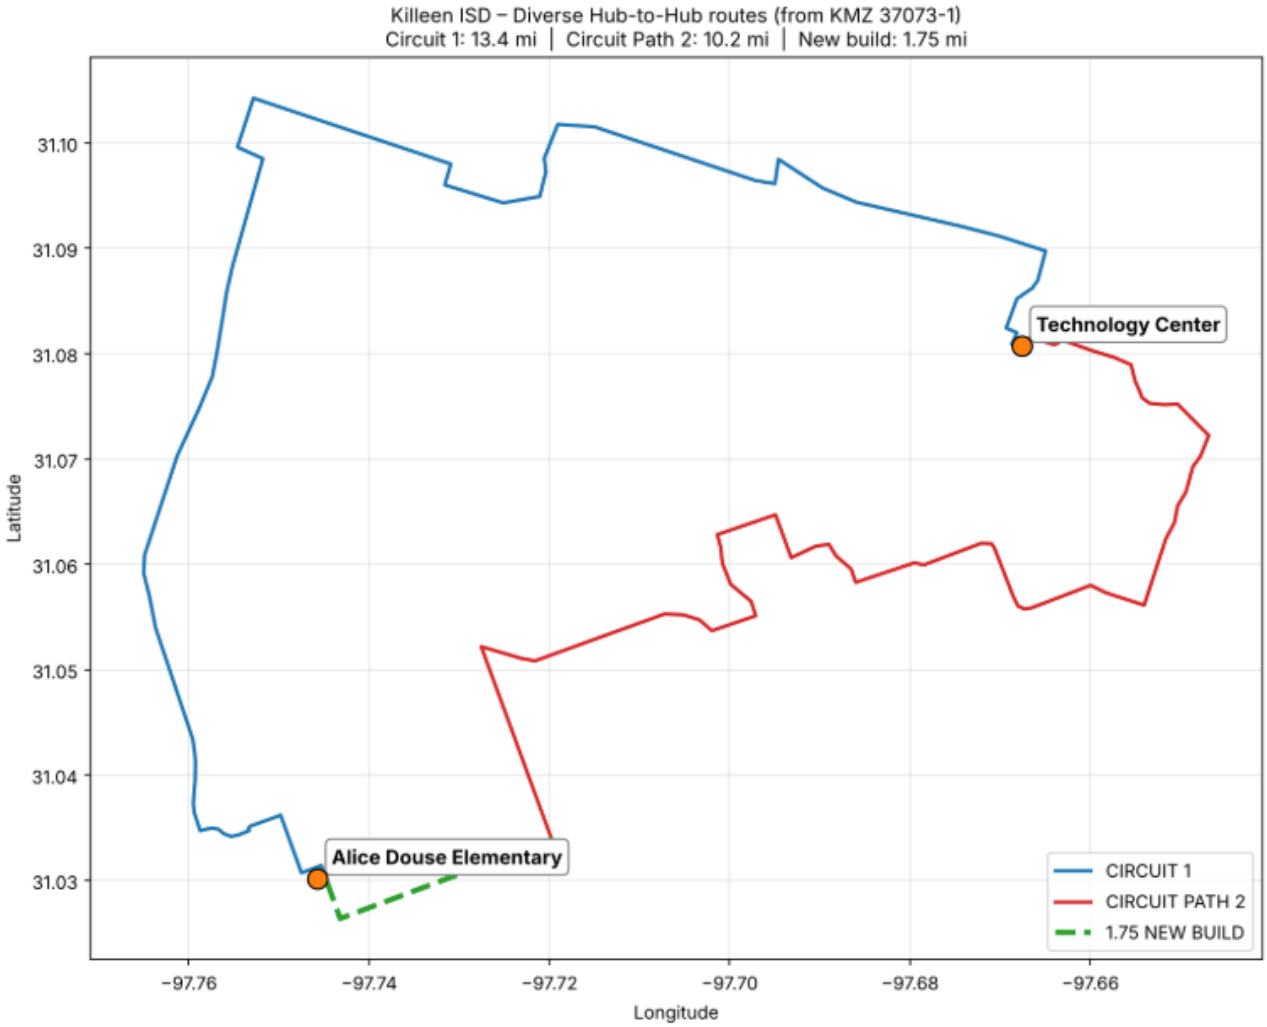
Question: Does it need to come from a different direction?

Answer: Yes. The fiber must come from an alternate path and not use the same path that is currently in use.

Question: The RFP requires the proposed 100 Gbps circuit between the Technology Service Center and Alice Douse Elementary School to be physically and geographically diverse from the existing circuit, including no shared fiber, conduit, or pole line. We did not see a KMZ/KML or other GIS file identifying the existing primary route. Would Killeen ISD please provide a KMZ/KML file, or equivalent detailed route information so we can accurately design and validate a fully diverse route?

Answer: The KMZ file was converted to PDF format and included in the RFP on page 8. Please refer to the diagram below for reference.

Revised Proposal DUE DATE: Tuesday, December 22, 2026
Proposals must be submitted online no later than 2:00 pm Central Time on the due date listed above.


Killeen ISD – Diverse Hub-to-Hub routes (from KMZ 37073-1)
Circuit 1: 13.4 mi | Circuit Path 2: 10.2 mi | New build: 1.75 mi
Technology Center
Alice Douse Elementary
CIRCUIT 1
CIRCUIT PATH 2
1.75 NEW BUILD
Latitude
Longitude
31.10
31.09
31.08
31.07
31.06
31.05
31.04
31.03
−97.76
−97.74
−97.72
−97.70
−97.68
−97.66